



---

## Louden Tribe 1.5MW Solar PV Install

Invitation to Bid No: LT-FY24-001

Opening Date: Friday January 19<sup>th</sup> 2024

Bid Due Date: Friday Feb 2<sup>nd</sup> 2024

### Louden Tribe Contact:

Brooke Sanderson

Louden Tribal Administrator Coordinator

907-656-1711

[brooke.sanderson@loudentribe.com](mailto:brooke.sanderson@loudentribe.com)

### Tanana Chiefs Conference Contact:

Edward Dellamary

T.C.C. Rural Energy Specialist

907-452-8251 x3279

[edward.dellamary@tananachiefs.org](mailto:edward.dellamary@tananachiefs.org)

## Contents

Louden Tribe Invitation to Bid LT-FY24-001 .....	3
SECTION 1 - Instructions to Bidders: .....	4
SECTION 2 - EVALUATION CRITERIA .....	6
Award: .....	6
Louden Tribe Invitation to Bid LT-FY24-001 .....	7
NON-COLLUSION AFFIDAVIT .....	8
Bid Schedule .....	9
CONTRACTORS QUALIFICATION QUESTIONNAIRE .....	10
Part 2 - General Provisions.....	11
Scope of Work .....	11
Measurement and Payment .....	11
Insurance Requirements .....	11
Part 3 – Map of Galena .....	14
Part 4 – Design Documents.....	15

## Louden Tribe Invitation to Bid LT-FY24-001

The Loudon Tribe (Tribe) requests proposals for the award of a contract for procurement, construction, installation and foundation work services for a 1.483 MW DC solar array in the community of Galena, AK whose power output will be integrated into the City of Galena owned electric distribution system via an Electrical RFP being put out at the same time. Contractors are encouraged to submit joint proposals on both RFPs if necessary to comprehensively meet the separate project components identified in the scope of services.

This Request for Proposals (RFP) details the overall scope of services desired, identifies specific qualifications, and required skills. Responses to this RFP will be used to select and negotiate with a qualified contractor(s) to provide the services described in the RFP. The Tribal Council will approve the award of this contract based on the evaluation criteria identified in this RFP.

This RFP is contingent on a grant being negotiated for funding and ***does not commit the Tribe to enter into a contract, nor does it obligate the Tribe to pay for any costs incurred in the preparation and submission of responses to this RFP.*** The funding for this project will be covered under a US Department of Energy Grant that has been conditionally approved but which is being negotiated as this RFP is out for bid. The Tribe reserves the right at its sole discretion: to make selections of one or more contractors, to reject any or all submissions, to issue subsequent RFPs, to remedy technical errors in the RFP process, and to enter into a contract for all or some of the services described in this RFP.

Proposals must be received by the Loudon Tribe, P.O. Box 244, Galena, Alaska 99741 or at the Tribal office located in Galena, Alaska 99741, by 4:30 p.m., local time on Friday February 2<sup>nd</sup>, 2024. All proposals must be emailed to Loudon Tribe Tribal Administrator Brooke Sanderson - [brooke.sanderson@loudontribe.com](mailto:brooke.sanderson@loudontribe.com) and their Project Manager at Tanana Chiefs Conference Edward Dellamary-[Edward.Dellamary@tananachiefs.org](mailto:Edward.Dellamary@tananachiefs.org). **Proposals received after the deadline will not be considered. FACSIMILE PROPOSALS WILL NOT BE ACCEPTED.**

**RFP documents and supporting information** may be obtained from Tanana Chiefs Conference at <https://www.tananachiefs.org/category/bids/> or by calling (907) 452-8251, ext. 3279 and reaching out to Ed Dellamary, TCC Energy Program Manager. Supporting information that is available include a map of the community, photos and an electrical planset.

Major components of the project are outlined in the attached plans and include the following:

1. Procurement and installation of a 1.483 MW DC solar PV system in Galena, AK targeted installation date spring/summer 2024 – contractor will need to comply with NEPA analysis guidelines and minimize wear and tear on the site during summer months – all grilling must take place while ground is frozen
2. Installation of all ground screw foundations for the Galena, AK solar array
3. Management of all material shipments into the community

The tribe reserves the right to waive informalities not inconsistent with the law and reject any or all bids.

Available on Tanana Chiefs Conference website: <https://www.tananachiefs.org/category/bids/>

## SECTION 1 - Instructions to Bidders:

The community of Galena, and project partners in the region are actively working to reduce diesel fuel consumption and costs and are moving toward diesels-off operation on their islanded microgrid through the use of solar energy, battery storage, and advanced grid-forming inverters and control systems. As a future component of the Galena Alaska microgrid system there will be a 1-2MW battery energy storage system. TCC Project Managers have confirmed with Ageto controller product designers that the system can be configured to work effectively in solar integration mode without the use of battery energy storage. A Battery Energy Storage System (BESS) will be integrated into the Galena Alaska Electric Grid at a future date and will be expected to integrate with the Ageto supervisory control however that portion of the project and the electrical portion of the solar project are not included as part of this RFP.

The Project is funded with both US Department of Energy Clean Energy Deployment on Tribal Lands funding and State of Alaska Renewable Energy Fund monies and must subscribe to pertinent DOE and State of Alaska requirements.

In addition to the above responsibilities, the Contractor will be required to:

- Travel to Galena
- Work together with the representatives of the following organizations during the stay in the Community and while performing the actual installation: Galena Tribal Council, City of Galena, Tanana Chiefs Conference, Sustainable Energy for Galena Alaska (SEGA)
- Use local labor force to maximum extent possible
- Provide training for community designated representatives, SEGA and CITY utility operators

Proposal Format: Proposals must be typewritten or prepared in ink and must be attached to the form provided in this RFP. No oral, telephone, or facsimile proposals will be accepted.

Conformance to Proposal Requirements: Proposals must conform to the requirements of the RFP. All necessary attachments (residency statement, references, descriptive literature, etc.) must be submitted with the proposal. Proposal rates must be stated as indicated in the proposal. Failure to comply with all requirements of the RFP may result in proposal rejection.

Exceptions: Any deviation from proposal specifications, terms and conditions may result in proposal rejection.

Time of Completion: Contractor must be able to complete the installation & integration of a solar array, battery and micro-grid controller installation before December 31, 2024. Contract shall terminate on or before March 30<sup>th</sup>, 2025, unless extended by mutual agreement.

Signature on Proposal: An authorized representative of the proposer must sign proposals in ink. Signature on a proposal certifies that the proposal is made without collusion with any person, firm, or corporation making a proposal for the same goods and/or services and is in all respects fair

and without collusion or fraud. Signature on a proposal also certifies that the proposal is accurate and truthful in all respects, and that proposer has read and fully understands all proposal specifications, terms, and conditions.

Proposal Modification: Modifications or deletions made before submitting a proposal must be initialed in ink by the person signing the proposal. Proposals, once submitted, may be modified in writing before the time and date set for proposal closing. Any modifications shall be prepared on the proposer's letterhead, signed by an authorized representative, and state that the new document supersedes or modifies the prior proposal. Modifications must be submitted in a sealed envelope clearly marked "Proposal Modification," and identify the proposal number and closing date.

Proposal Withdrawals: Proposals may be withdrawn in writing on proposer's letterhead signed by an authorized representative and received by the Tribe prior to proposal closing time. Proposals may also be withdrawn in person before proposal closing time upon presentation of appropriate identification.

Protest of Proposal Specifications: A proposer who believes proposal specifications are unnecessarily restrictive or limit competition may submit a protest, in writing, to the Tribal Council. To be considered, protests must be received at least five (5) days before the proposal closing date. Envelopes containing protests should be marked as follows: *"Louden Solar PV Electric, Com, Controller RFP LT-FY24-001"*

Required Effort: Per Louden Tribe procurement guidelines, The Louden Tribe must make a good faith effort to ensure that small businesses and minority owned business, women's business enterprises and individuals or firms located within or owned in substantial part by persons residing in the area of a Louden Tribe project are used when possible

## **SECTION 2 - EVALUATION CRITERIA**

The Tribe's Evaluation Committee will evaluate the RFP responses. The Committee will consider how well the proposal meets the Tribe's requirements as described in the RFP. It is important that the responses are clear and complete to ensure that the Committee can adequately understand all aspects of the proposal.

### **Minimum Criteria (no points)**

1. At least 3 years in business
2. Significant, demonstrable experience with hybrid renewable-diesel power systems
3. Significant, demonstrable experience designing & installing Solar PV arrays in Alaska
4. At least 3 references from clients in Alaska

### **Criteria to be Scored**

1. Price
2. Scope of Services
3. Prior experience performing similar work
4. A plan of commitment to use local hire for additional work and train them
5. Recommendation from References

### **Award:**

The Loudon Tribe review committee may consist of but is not limited to the Tribal Administrator, City of Galena Utility Manager, City of Galena City Manager, Tanana Chiefs Conference Energy Project Managers, Tribal Council Staff and the General manager for Sustainable Energy for Galena (SEGA), Alaska. The Tribe reserves the right to modify the membership of the Evaluation Committee.

The Evaluation Committee will rank the proposals against the criteria in this RFP and submit its recommendation to the council for approval and execution of a professional services agreement. The Council will award the contract at its sole discretion and judgment.

Louden Tribe may reject any proposal not in compliance with all prescribed bidding procedures and requirements in this RFP, and may reject any proposals upon a finding that it is in the Tribe's interest to do so. The Tribe also reserves the right to waive any informality in any proposal and to delete matters from proposals if not prohibited by law.

## Louden Tribe Invitation to Bid LT-FY24-001

Bid of \_\_\_\_\_  
(hereinafter called "BIDDER"), organized and existing under the laws of the State of \_\_\_\_\_  
doing business as \_\_\_\_\_\*,  
to the LOUDEN TRIBE, a federally recognized tribe (hereinafter called "OWNER").

In compliance with your Advertisement for Bids, BIDDER hereby proposes to perform all WORK for the **Louden Tribe 1.5MW Solar PV Install**, in strict accordance with the CONTRACT DOCUMENTS, within the time set forth therein, and at the prices stated below.

By submission of the BID, each BIDDER certifies, and in the case of a joint BID each party thereto certifies as to his own organization, that this BID has been arrived at independently, without consultation, communication, or agreement as to any matter relating to the BID with any other BIDDER or with any competitor.

BIDDER hereby agrees to commence WORK under this contract on or before a date to be specified in the NOTICE TO PROCEED and to fully complete the PROJECT by December 31st, 2024. BIDDER further agrees to pay any liquidated damages in accordance with the Contract Documents.

BIDDER agrees to perform all the work described in the CONTRACT DOCUMENTS for the following unit prices or lump sum (Show total Price) :

*Respectfully submitted:*

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Address

\_\_\_\_\_  
Title

\_\_\_\_\_  
Telephone Number

\_\_\_\_\_  
Date

---

## NON-COLLUSION AFFIDAVIT

UNITED STATES OF AMERICA

STATE OF ALASKA

I, \_\_\_\_\_, of \_\_\_\_\_,  
(Name of Officer) (Firm Name)

being duly sworn, do depose and state:

That I, or the firm, association or corporation of which I am a member, a bidder, on the contract to be awarded, by the Loudon Tribe of the State of Alaska, for the construction of that certain project designated as: the **Louden Tribe 1.5MW Solar PV Install**, located in Galena, Alaska, in the State of Alaska, have not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract.

\_\_\_\_\_  
(Signature)

Subscribed and sworn to this \_\_\_\_\_ day of \_\_\_\_\_, 2024.

\_\_\_\_\_  
Notary Public  
My Commission Expires:



### Bid Schedule

The Bidder shall insert a unit bid price or a lump sum price in figures opposite each pay item and total price for which an estimated quantity appears in the bid schedule. The estimated quantity of work for payment on a lump sum basis will be “all required” and as further specified in the contract.

Louden Tribe BID SCHEDULE		Louden Solar PV and Microgrid Controller
Project LT-FY24-001		
Item No.	Item Description	Amount Bid
001	Foundation work – procurement and installation of ground screws required for PV array	
002	Procurement and installation of APA Racking system and solar panels for installation on ground screws	
	Total Bid:	

## CONTRACTORS QUALIFICATION QUESTIONNAIRE

### A. FINANCIAL

1. Have you ever failed to complete a contract due to insufficient resources?

☐ No ☐ Yes If YES, explain:

2. Describe any arrangements you have made to finance this work:

### B. EQUIPMENT

1. Describe the equipment you have available and intend to use for this project. List the item, quantity, make, model, size/capacity and present market value.

2. What percent of the total value of this contract do you intend to subcontract? \_\_\_\_\_ %

3. Do you propose to purchase any equipment for use on this project?

☐ No ☐ Yes If YES, describe type, quantity, and approximate:

4. Do you propose to rent any equipment for this work?

☐ No ☐ Yes If YES, describe type and quantity:

5. Is your bid based on firm offers for all materials necessary for this project?

☐ Yes ☐ No If NO, please explain:

### C. EXPERIENCE

1. Have you had previous construction contracts or subcontracts in a Rural Community?

☐ No ☐ Yes (If yes where and please provide contact info)

Describe the most recent or current applicable contract, its completion date, and scope of work:

2. List, as an attachment to this questionnaire, other construction projects you have completed, the dates of completion, scope of work, and total contract amount for each project completed in the past 5 years which are pertinent to this project.

**I hereby certify that the above statements are true and complete.**

\_\_\_\_\_  
Name of Contractor

\_\_\_\_\_  
Name and Title of Person Signing

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Date

## **Part 2 - General Provisions**

### **Scope of Work**

The Loudon Tribe is releasing this bid document for the procurement and installation of a 1.483MW grid-tied solar PV array in the community of Galena, Alaska. The associated electrical will be put out in an adjacent electrical, communication and controller RFP. The work will include a small amount of clearing but the majority of the site is clear. Foundation work will need to be completed during months when the ground conditions are frozen. Any work completed during spring or summer months will need to be done in such a way that ground disturbance is minimized otherwise the contractor will be responsible for re-vegetation of the site. Contractor is responsible for acquiring their own housing in the community of Galena. Contractor is responsible for the procurement of all material and shipping of said material into the community. Local barge vendors that serve the community include Ruby Marine based in Nenana, AK.

1. The community in partnership with Tanana Chiefs Conference has completed extensive design work over the past 18 months and a planset is available as part of this packet and will be used as the basis of design
2. Although we have not procured solar modules for this project yet we have identified SEG 550 watt bifacial monocrystalline panels as the basis of design.
3. AP Alternatives racking and 10' long 3" diameter ground screws have been specified for this project with a 40 deg tilt
4. It is expected that the project will need to utilize Davis Bacon wage rates since federal funds are being utilized

### **Measurement and Payment**

Payment for the project will be in the form of multiple completion milestones and payment dates once an eligible contractor is selected. Contractor will be paid after receipt of properly prepared invoices. Loudon Tribe and their consultants/Partners will inspect and approve all work to ensure it complies with applicable codes and standards. Any concerns or issues that the city has with the contractors work as completed will be addressed by a 3<sup>rd</sup> party arbitrator if they cannot be resolved between the tribe and contractor directly. No final payment will be made until the tribe is confident that all work has been completed to their standards and specifications.

### **Insurance Requirements**

The Loudon Tribe shall be named as an additional insured on all insurance policies required for this project. All of the insurance coverages shall be considered to be primary and noncontributory to any other insurance carried by the Loudon Tribe, whether through self-insurance or otherwise.

All specialty trades such as electrical, plumbing and mechanical must have appropriate licensing and be certified by the State of Alaska for the work being performed.

### **Certificate of Insurance**

Contractor must furnish a certificate of insurance within the (10) days of receipt of the Notice-of-Intent to Award and must endorse policies to provide for a thirty (30) day prior notice of cancellation, nonrenewal or material change of the policies. Failure to furnish satisfactory evidence of insurance or lapse of policy is a material breach of the contract and grounds for termination of this agreement. Each policy shall be endorsed with a waiver of subrogation in favor of the Owner. All other insurance policies required of the Contractor by this agreement shall be endorsed to provide that such insurance shall apply as primary insurance and that any insurance or self-insured carried by the Owner will be excess only and will not contribute with the insurance required by this agreement. All other insurance policies required of the Contractor and subcontractors by this Agreement shall be endorsed to name the Owner as additional insured. All insurance shall be on an occurrence from acceptable to the Owner and having an A.M. Best rating of "A" or better.

1. Workers' Compensation and Employers' Liability Insurance as required by any applicable law or regulation. Employers' liability insurance shall be in the amount no less than \$500,000 each accident for bodily injury, \$500,000 policy limit for bodily injury by disease and \$500,000 each employee for bodily injury by disease. The Contractor shall be responsible for Workers' Compensation Insurance for any subcontractor who directly or indirectly provides services under this contract. This coverage must include statutory coverage for states in which employees are engaging work. If there is an exposure of injury to Contractor's employees under the U.S. Longshoremen's Harbor Workers' Compensation Act, the Jones Act, or under laws, regulations or statutes applicable to maritime employee, coverage shall be included for such injuries or claims. The coverage shall include waiver of subrogation against the City.

2. Commercial General Liability Insurance: The Contractor is required to provide Commercial General Liability (CGL) insurance with limits not less than \$2,000,000 combined single limit per occurrence and \$2,000,000 in the aggregate not excluding premises operations, independent contractors, products, and completed operations, broad form property damage, blanket contractual, explosion, collapse and underground hazards. **Limits may be a combination of primary and excess (umbrella) policy forms.**

3. Comprehensive Automobile Liability Insurance: Covering all owned hired and non-owned vehicles with coverage limits not less than \$500,000 single limit per occurrence bodily injury and property damage.

4. Property Insurance: The Contractor shall submit to the Owner evidence of All Risk Builder's Risk Insurance for all physical loss, including earthquake and flood (100% completed value basis) upon the entire work naming the Owner, the Contractor and the subcontractors as additional insured parties and as their interests may appear to the full contract sum thereof, until the project is completed by the Contractor and accepted by the Owner. The policy, by endorsement, shall specifically  
State "Louden Tribe Solar PV and Microgrid Controller"

A. PROOF OF INSURANCE: The Contractor shall furnish the Owner with a Certificate of Insurance or where requested by the Owner, the policy declaration page with required endorsements attached thereto showing the type, amount, effective dates and dates of expiration of all policies. All endorsements shall reference policy number and the project name and project number. The Owner is the Loudon Tribe and is to be identified on all certificates and endorsements.

B. To the fullest extent permitted by law, the Contractor shall defend, indemnify and hold harmless the Loudon Tribe its officers, and employees from and against any and all loss, expense, damage, claim, demand, judgment, fine, charge, lien, liability, action, cause of action, or proceedings of any kind whatsoever (whether arising on account of damage to or loss of property, or personal injury, emotional distress or death) arising directly or indirectly in connection with the performance or activities of the Contractor hereunder, whether the same arises before or after completion of the contractor's operations or expiration of this Agreement, except for damage, loss or injury resulting from the Owner's gross negligence or willful misconduct.

C. Without limiting its indemnification, the Contractor shall maintain, until acceptance of the project by the Owner, occurrence type coverage of the kinds and minimum amounts set forth above. All insurance limits are minimum. If the Contractor's policy contains higher limits, the Owner shall be entitled to coverage to the extent of such higher limits. The Owner, at its sole discretion, may raise or lower the limit.

## **Part 3 – Map of Galena**




Community Map  
GALENA

64° 44' 10" N 156° 54' 49" W (NAD 83)  
Approximate Elevation: 153' at Airport CL Mon.  
Township 9 South, Range 10 East, K.R.M., AK  
U.S.G.S. Quadrangle "NULATO C2-C3-D2-D3", Alaska  
NULATO RECORDING DISTRICT

LEGEND

- Residential Building
- Commercial Building
- Public Building
- Edge of Water
- Electric
- Underground Telephone
- ANCSA 17(b) Easements




SCALE: 1"=200'  
Date of Photography: July 10, 2009  
Magnetic Declination computed by U.S.G.S. Geomag  
Program using WMM-2005.COF model as of September 12, 2009  
SHEET 4 of 8

MAP NOTES  
This map was prepared by the Alaska Department of Commerce, Community, and Economic Development, Division of Community and Regional Affairs (Commerce) using funding from Federal Emergency Management Agency and US Department of the Interior Bureau of Indian Affairs. Commerce contracted with Global Positioning Services, Inc. in June of 2009 to prepare the map.  
This map should not be construed as a survey. On-site surveys should be conducted prior to engineering or construction. This map was compiled to meet horizontal and vertical accuracy in accordance with national map accuracy standards.  
Property and utility information has been generated from readily available sources with limited accuracy checks. Property information is not intended to represent a title search of the Records Office record. Utility location is approximate and shows only the main lines. Generally, the information is current as of December 2009. ANHC provided sanitation facility records.  
This map is based on photography acquired on July 7 & 10, 2009, at a nominal scale of 1 in = 800 ft. Aero-Metric Anchorage prepared the orthophoto and topographic mapping. The topographic contours were prepared at two (2) foot intervals with index contours every ten (10) feet.

FLOOD NOTES  
The US Army Corps of Engineers (USACE) report "Alaska Communities Flood Hazard Data 2009", has a published flood of record which occurred in 1971 with a flood elevation of 134.7 Mean Sea Level (MSL) (1943 Datum) at "Old Town". The flood control dike surrounding the Air Force Base was constructed at 136 ft Mean Sea Level (MSL) (1943 Datum). Published Flood Insurance Maps (FIRM) show detailed flood plain information. In 1995, The U.S. Geological Survey (USGS) re-adjusted the vertical datum. The 1955 datum is 23.3' higher than the 1943 datum.

- BUILDING KEY**
1. Christian Church
  2. Coffee Shop
  3. Daycare Center
  4. School
  5. School
  6. School Maint.
  7. High School
  8. Elementary School
  9. City Pool
  10. City Clinic
  11. Elders Home
  12. Court House
  13. Louden Offices
  14. B&B
  15. Store
  16. Store
  17. Sweetirs Store
  18. Radio Station
  19. Radio Station
  20. Business Hall

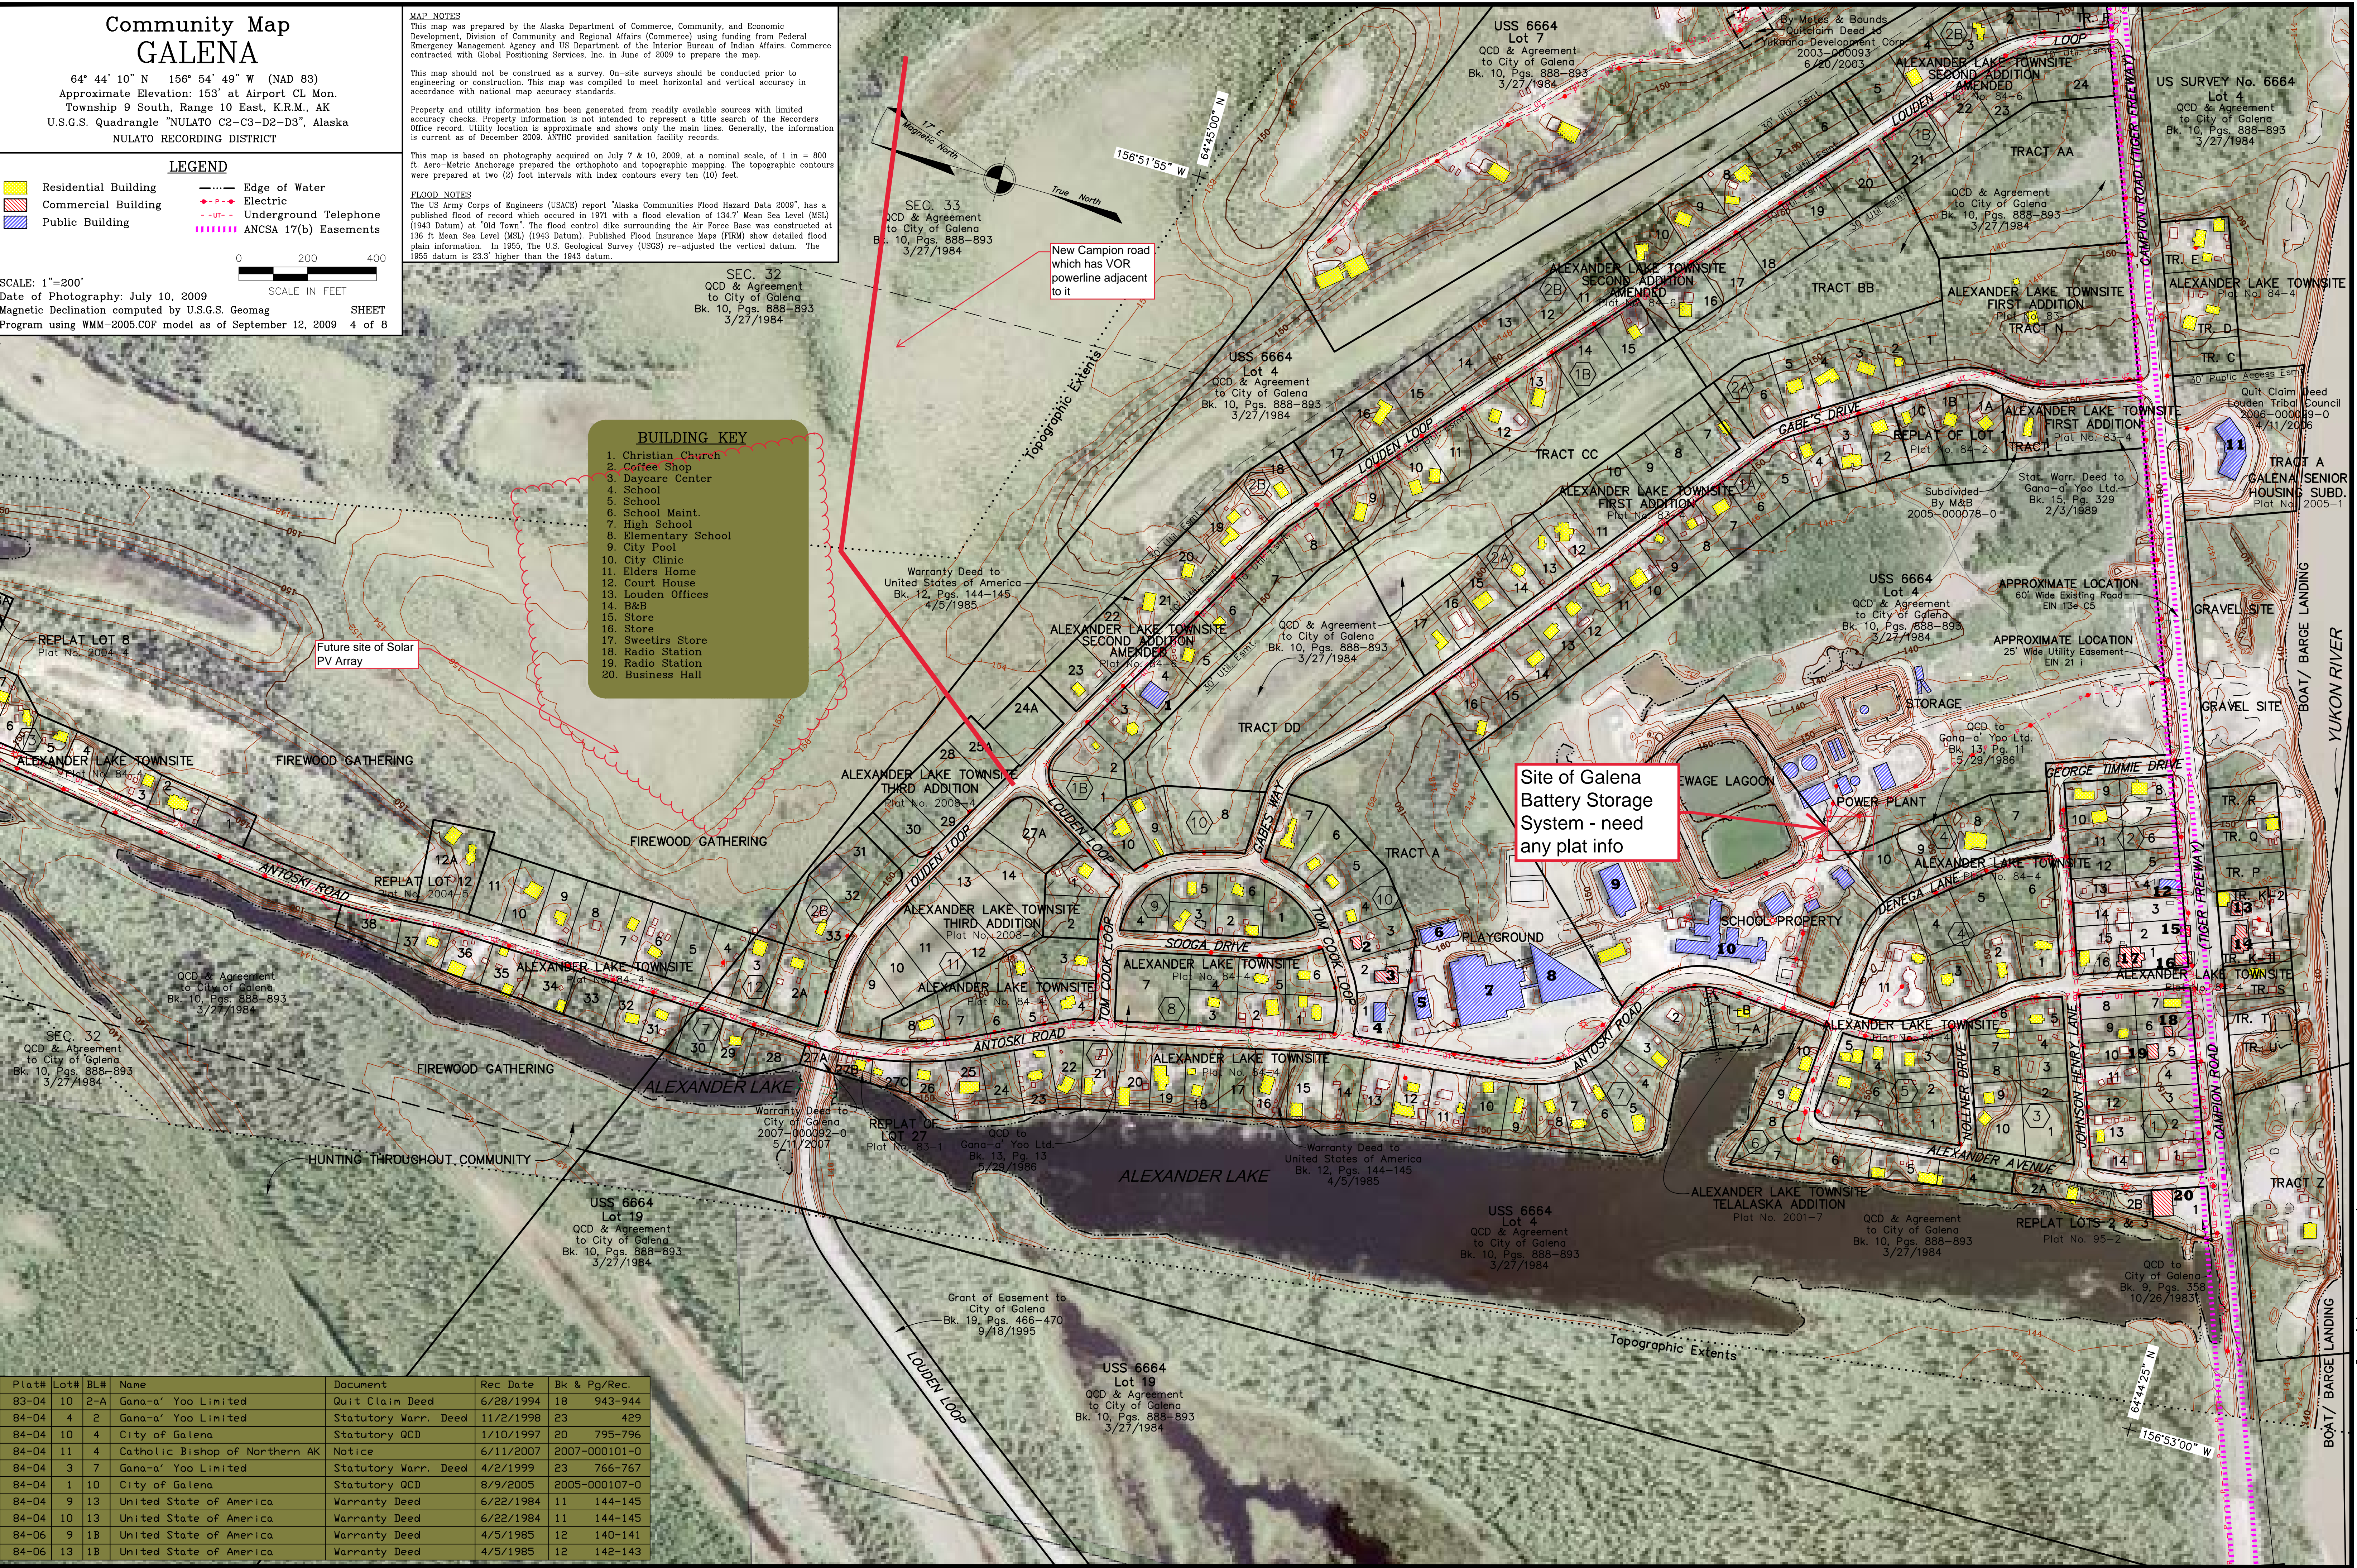

Plat#	Lot#	BL#	Name	Document	Rec Date	Bk & Pg/Rec.
83-04	10	2-A	Gana-a' Yoo Limited	Quit Claim Deed	6/28/1994	18 943-944
84-04	4	2	Gana-a' Yoo Limited	Statutory Warr. Deed	11/2/1998	23 429
84-04	10	4	City of Galena	Statutory QCD	1/10/1997	20 795-796
84-04	11	4	Catholic Bishop of Northern AK	Notice	6/11/2007	2007-000101-0
84-04	3	7	Gana-a' Yoo Limited	Statutory Warr. Deed	4/2/1999	23 766-767
84-04	1	10	City of Galena	Statutory QCD	8/9/2005	2005-000107-0
84-04	9	13	United State of America	Warranty Deed	6/22/1984	11 144-145
84-04	10	13	United State of America	Warranty Deed	6/22/1984	11 144-145
84-06	9	1B	United State of America	Warranty Deed	4/5/1985	12 140-141
84-06	13	1B	United State of America	Warranty Deed	4/5/1985	12 142-143



## **Part 4 – Design Documents**

1. Electrical Planset
2. APA Titan Duo Solar Racking- PLEASE NOTE: THIS PLANSET IS REPRESENTATIVE ONLY OF THE TYPE OF RACKING BASED ON THE SIMILAR TYPE OF RACKING USED FOR THE GALENA PILOT PROJECT.
3. Solar Panel Specification
4. Inverter Specifications





## STANDARD SPECIFICATIONS

**Engineering:** ASCE 7-10/7-16/CPP Wind Tunnel Tested

**Grounding:** Fully Integrated UL2703

**Foundation:** Dual Ground Screw

**Tilt Angles:** 5°-35° Tilt Options

**Racking Coating:** Galvanized; G90

**Foundation Coating:** HDG

**Wind Loading:** Up to 165mph


**Snow Loading:** Up to 100psf

**Mounting Orientation:** 2-High in Portrait

**Warranty:** 25 Years

## DUAL GROUND SCREWS

TITAN Duo is designed to tackle the most challenging sites. The dual ground screw foundation is the perfect solution for glacial till, cobble, hardpan, or solid bedrock. The heavy walled tube and welded connections allow for massive amounts of torque and pressure to be applied, helping the screw advance into the toughest soils.

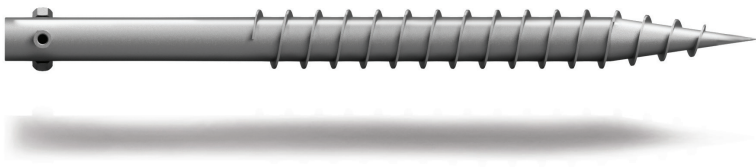

## TITAN<sup>DUO</sup>

Designed by installers for installers, **TITAN<sup>™</sup>** is the most advanced hardware in the industry. TITAN's unique asymmetrical design and innovative features allow for flexibility in the field while streamlining the install process. With the lowest part count per MW, integrated grounding and cable trays, and the fully integrated, patented module Gravity Clip<sup>™</sup>, TITAN is installers preferred choice. The 3-rail design is an excellent solution for bifacial modules with low backside shading. TITAN Duo comes standard with dual 3" diameter ground screws for rocky soil conditions.

*In business since 2008, APA offers a versatile line of racking and foundation solutions for projects in even the most challenging environments. With projects nationwide, APA is a trusted racking partner.*

# WHY USE TITAN DUO™?

## ASYMMETRICAL 3-RAIL DESIGN


- 25% Less East-West rails
- Lowest part count per MW
- 2-High Portrait, ideal for split cell modules
- Low back panel shading for bifacial modules

## TELESCOPING POST

Allows for quick adjustment in the field for high degrees of topography on site.

## WIRE MANAGEMENT

Integrated cable trays and custom wire clips keep your project organized, safe, and code compliant for the life of the project, without costly third-party solutions.



## GROUND SCREWS STANDARD

TITAN Duo is specifically designed for sites with glacial till, cobble, hardpan and bedrock.


## ADJUSTABLE BRACING

C-channel bracing allows for easy adjustments in the field.

## PATENTED GRAVITY CLIP™

- Fully integrated module grounding
- Allows for rapid installation of modules
- Accommodates different module widths
- Lock clip won't loosen from ice for vibrations



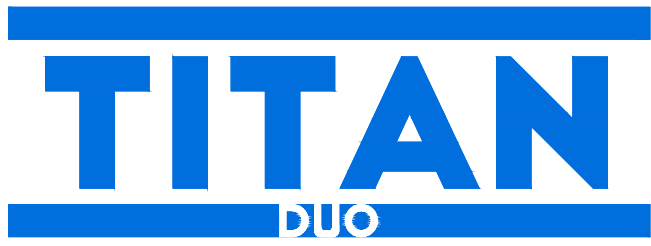

----

GALENA  
GALENA, AK 99741

CONSTRUCTION SET

APPROVED

SOLAR PHOTOVOLTAIC ARRAY

PROJECT NUMBER: 220925

REV: A  
2/16/2023

CUSTOMER



TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM


STRUC. ENGINEER OF RECORD



360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161  
[F] 419.725.7160

VICINITY MAP

COORDINATES: 64.753220, -156.876862

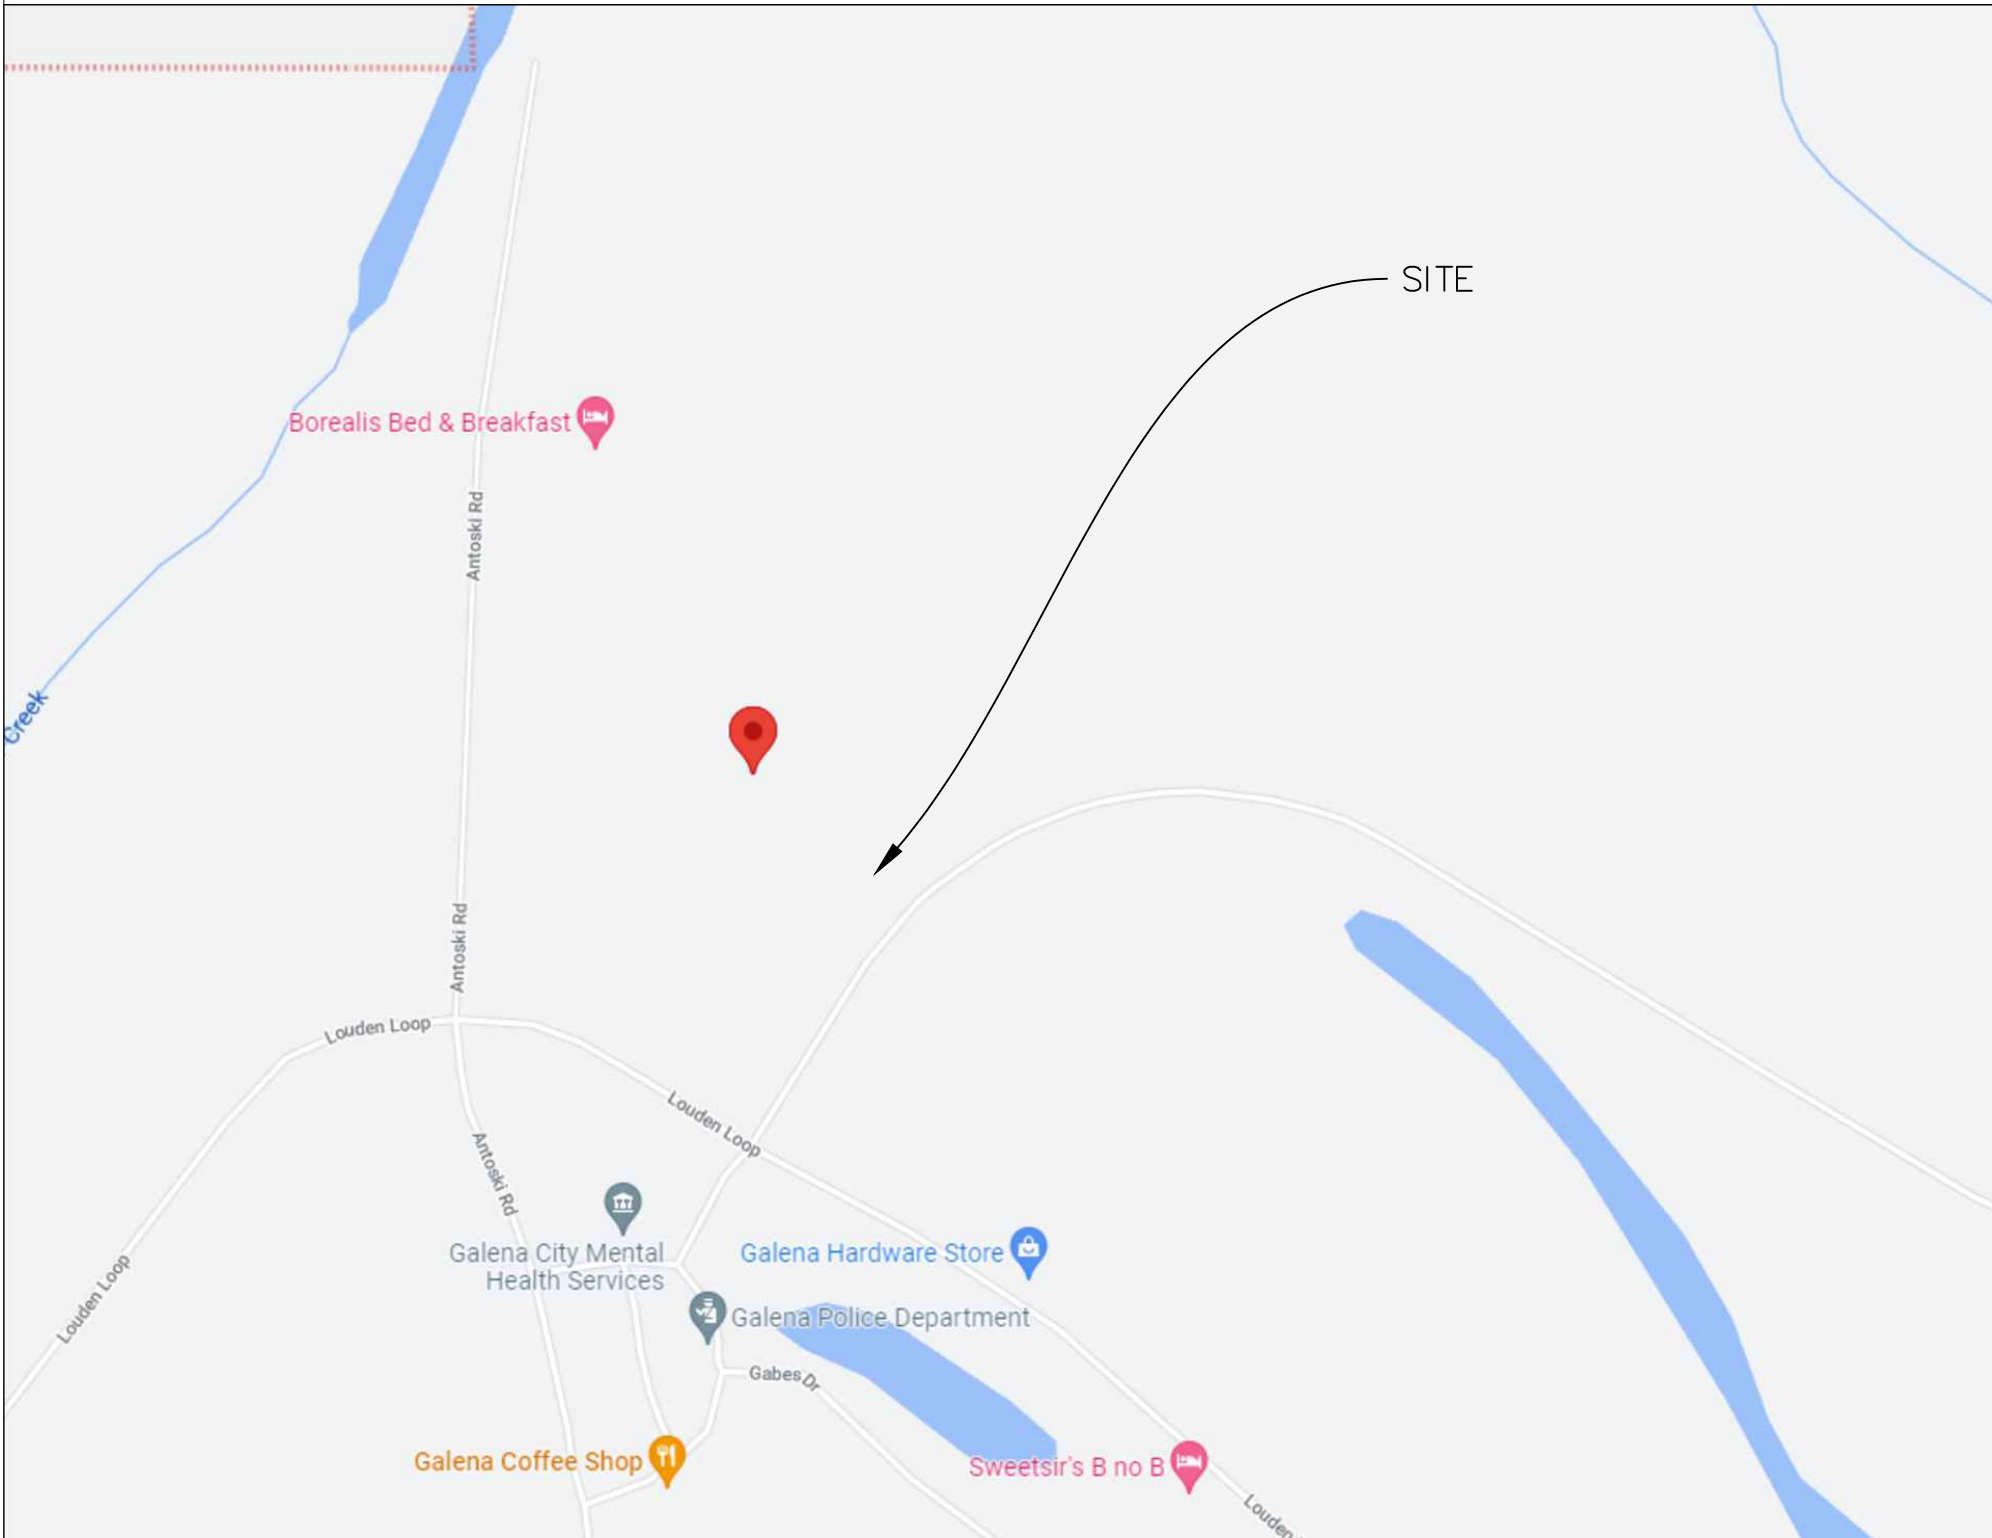

SHEET INDEX - CONSTRUCTION		
GENERAL		REV
G-000	COVER SHEET	A
G-100	PROJECT NOTES	A
G-200	PV MODULE SPEC SHEET	A
G-300	RACKING DIMENSIONS	A
G-301	RACKING DIMENSIONS	A
G-302	4-RAIL TRANSVERSE BRACE: 92.5" SPANS	A
LAYOUT		
L-100	SITE LAYOUT	A
L-150	ROW TECHNICAL DATA	A
L-200	SITE FOUNDATIONS: OVERVIEW	A
L-300	SITE TABLES: OVERVIEW	A
L-400	SITE TRANSVERSE BRACES: OVERVIEW	A
L-500	SITE CABLES: OVERVIEW	A


FOUNDATION EMBEDMENT DATA	
HELIX SIZE	EMBEDMENT DEPTH
3" x 110"	104"

PROJECT SPECIFICATIONS	
GENERAL	
SOLAR PANEL	0 CELLS
PANEL WATTAGE	575 W
PANEL STYLE	156 CELL
PANEL QTY	88
SITE WATTAGE (KW)	50.60
TILT ANGLE	40°
FRONT LIP CLEARANCE	36"

SITE PLAN



COUNTY MAP

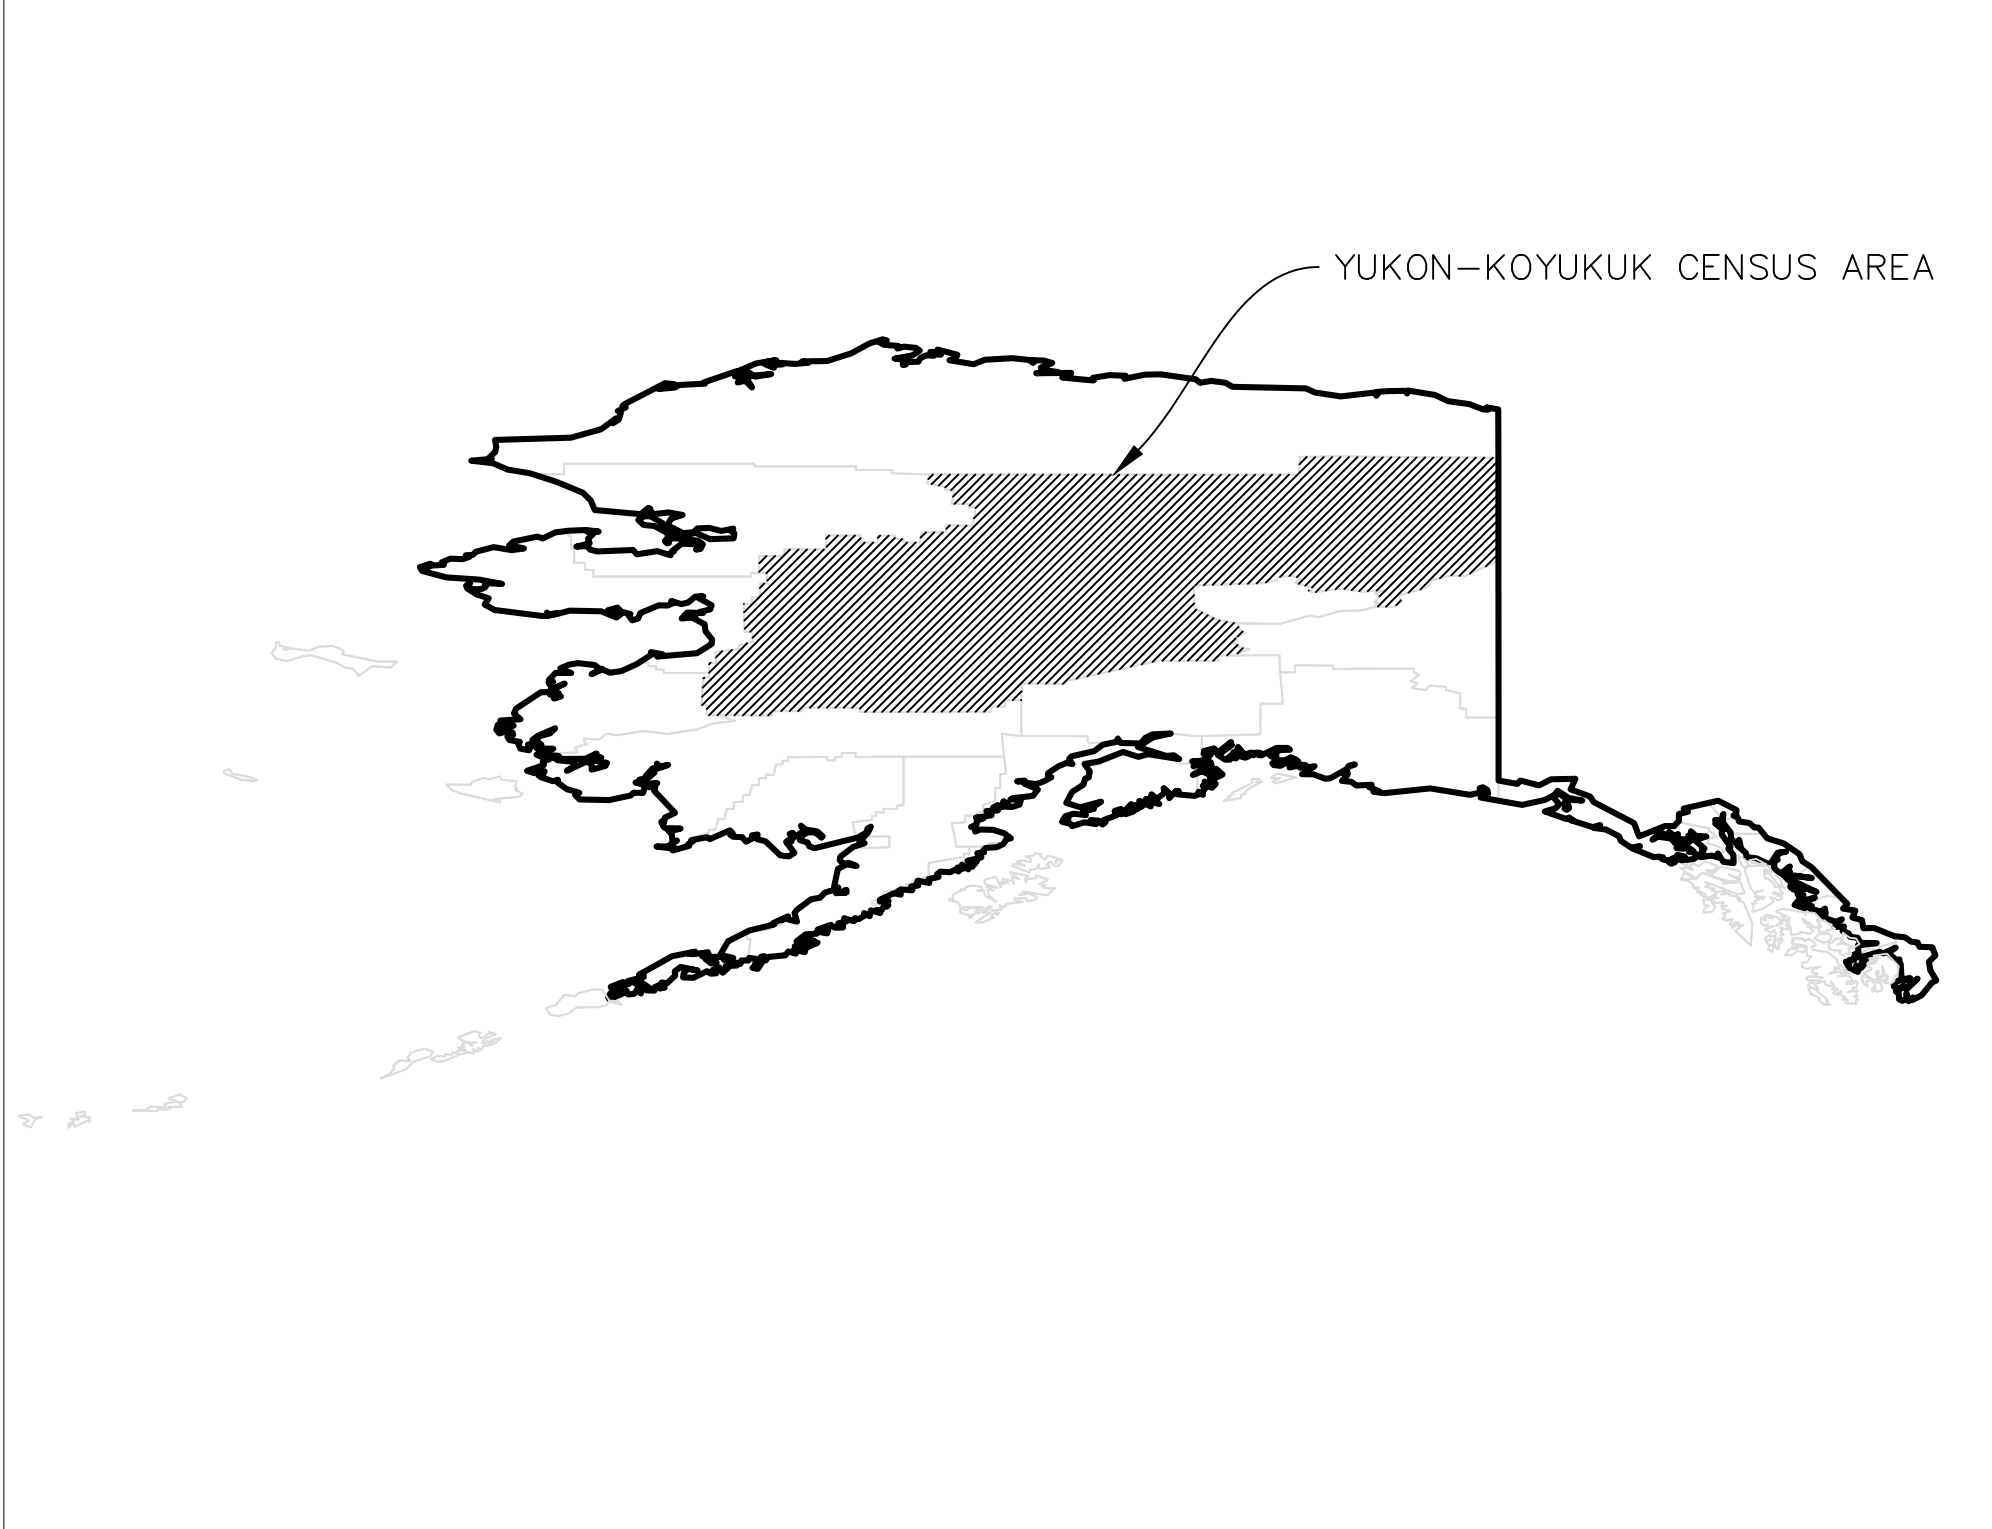

DRAWING NUMBER: G-000



### LEGEND

- |                              |  |
|------------------------------|--|
| FENCELINE                    |  |
| EASEMENT                     |  |
| PROPERTY LINE                |  |
| CARTRIDGE (2 PV MODULES)     |  |
| FOUNDATION POST (FOUNDATION) |  |
| CABLE BRACING                |  |
| SURVEY POINTS                |  |
| REVISION CLOUD               |  |
| REVISION ID TAG              |  |
| COMPRESSION TEST LOCATION    |  |
| TENSION TEST LOCATION        |  |
| DRIVABILITY TEST LOCATION    |  |
| FOUNDATION POST NUMBER       |  |
| ROW NUMBER                   |  |

## ELECTRICAL

- | SPECIAL INSPECTION & TESTING SCHEDULE   |            |          |
|---|------------|----------|
|   | CONTINUOUS | PERIODIC |
| STRUCTURAL STEEL FABRICATION  |            |          |
| MATERIAL IDENTIFICATION   |            | X        |
| HIGH STRENGTH BOLTS – MATERIAL IDENTIFICATION OF BOLTS, NUTS, & WASHERS                     |            | X        |
| WELD FILLER MATERIALS – IDENTIFICATION AND CONFIRMATION OF COMPLIANCE WITH DESIGN DOCUMENTS |            | X        |
| STRUCTURAL STEEL ERECTION   |            |          |
| MATERIAL IDENTIFICATION   |            | X        |
| INSTALLATION OF HIGH STRENGTH BOLTS   |            | X        |
| WELDED CONNECTIONS  |            | X        |
| MEMBER SIZES AND PLACEMENT  |            | X        |
| GENERAL CONFORMANCE WITH DESIGN DOCUMENTS   |            | X        |
| DRIVEN DEEP FOUNDATION ELEMENTS   |            |          |
| VERIFY ELEMENT MATERIALS, SIZE, LENGTHS COMPLY WITH DESIGN DOCUMENTS                        | X          |          |
| DETERMINE CAPACITIES OF TEST ELEMENTS & CONDUCT ADDITIONAL LOAD TESTS, AS REQ.              | X          |          |
| OBSERVE DRIVING OPERATIONS, MAINTAIN RECORDS  | X          |          |
| VERIFY PLACEMENT LOCATIONS & PLUMBNESS  | X          |          |

THIS TABLE PER IBC 2012, TABLE 1705

## CONSTRUCTION

- SPECIAL INSPECTION
- SPECIAL INSPECTIONS ARE NOT REQUIRED BY APA  
SOLAR OR THE STRUCTURAL ENGINEER OF RECORD.  
THE JDI GROUP. WHERE REQUIRED BY OWNER,  
CUSTOMER, AND/OR AUTHORITY HAVING  
JURISDICTION, MINIMUM INSPECTION SHALL INCLUDE  
THE FOLLOWING NOTES AND TABLE BELOW.

## SPECIAL INSPECTION

1. STRUCTURAL PRINTS CONTAIN ONLY MAXIMUM ALLOWABLE SPANS, FOR FIELD CONSTRUCTION FOUNDATION SPACING, REFER TO DIMENSIONS IN CONSTRUCTION SET.
2. CUSTOM FOUNDATION SPACING MAY BE PRESENT AT ENDS OF ROW, DEPENDENT ON ROW LENGTH.
3. START OVERHANG DIMENSIONS MEASURED FROM

CUSTOMER



TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



STRUCTURAL ENGINEER OF RECORD



360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME: **GALENA**  
 SITE ADDRESS: \_\_\_\_\_  
 SITE CITY, STATE: **GALENA, AK 99741**

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/16/2023

[ APPROVED ]

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D

PROJECT NOTES

PROJECT NUMBER

220925


DRAWING NUMBER

G-100


REV.	SIZE	DATE	GALENA, AK 99741
A	D	16/2023	




SCALE IS REDUCED WHEN SHEET SIZE IS 11" x 17"

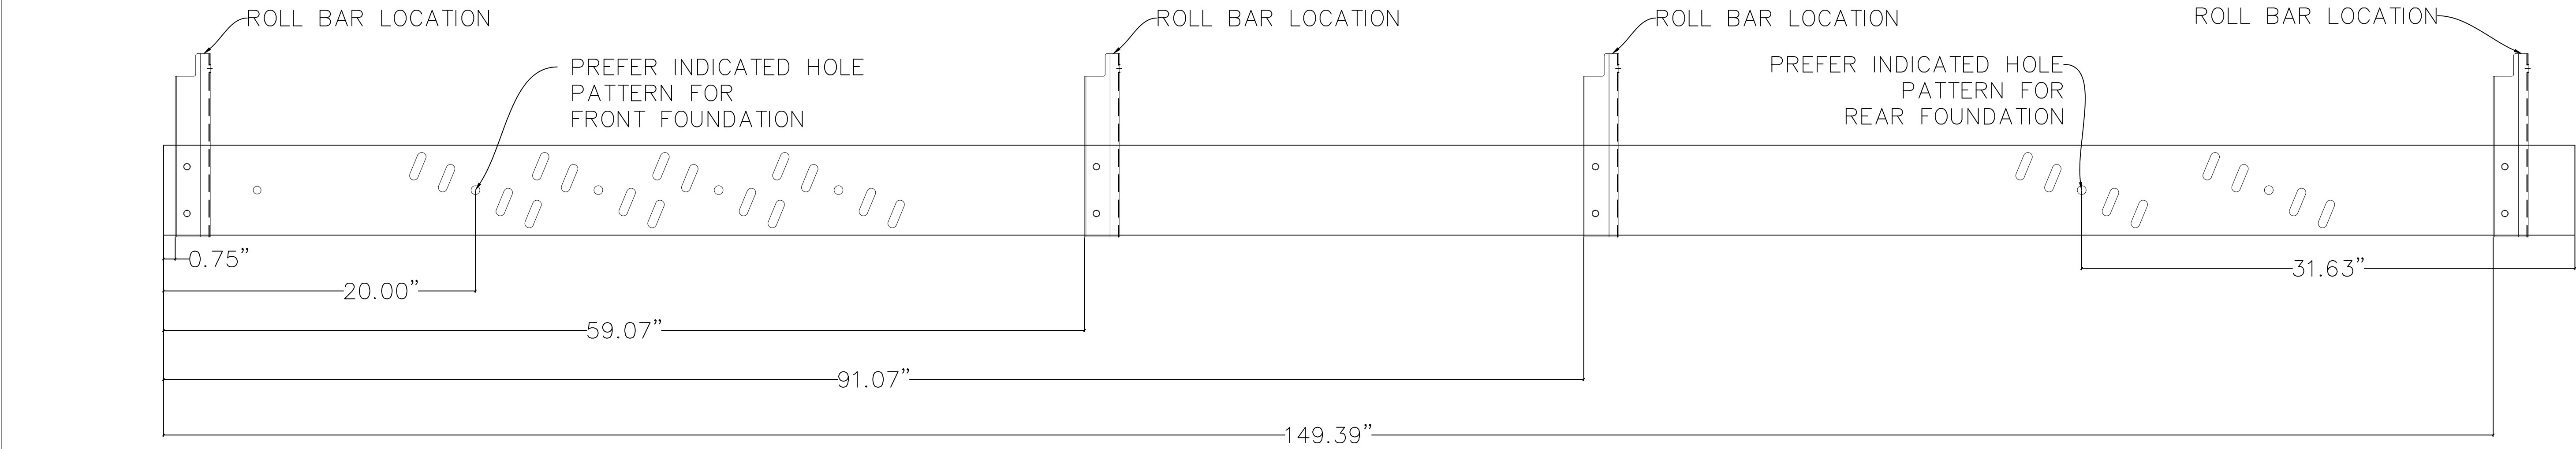


D1 CHORD CONNECTION POINTS

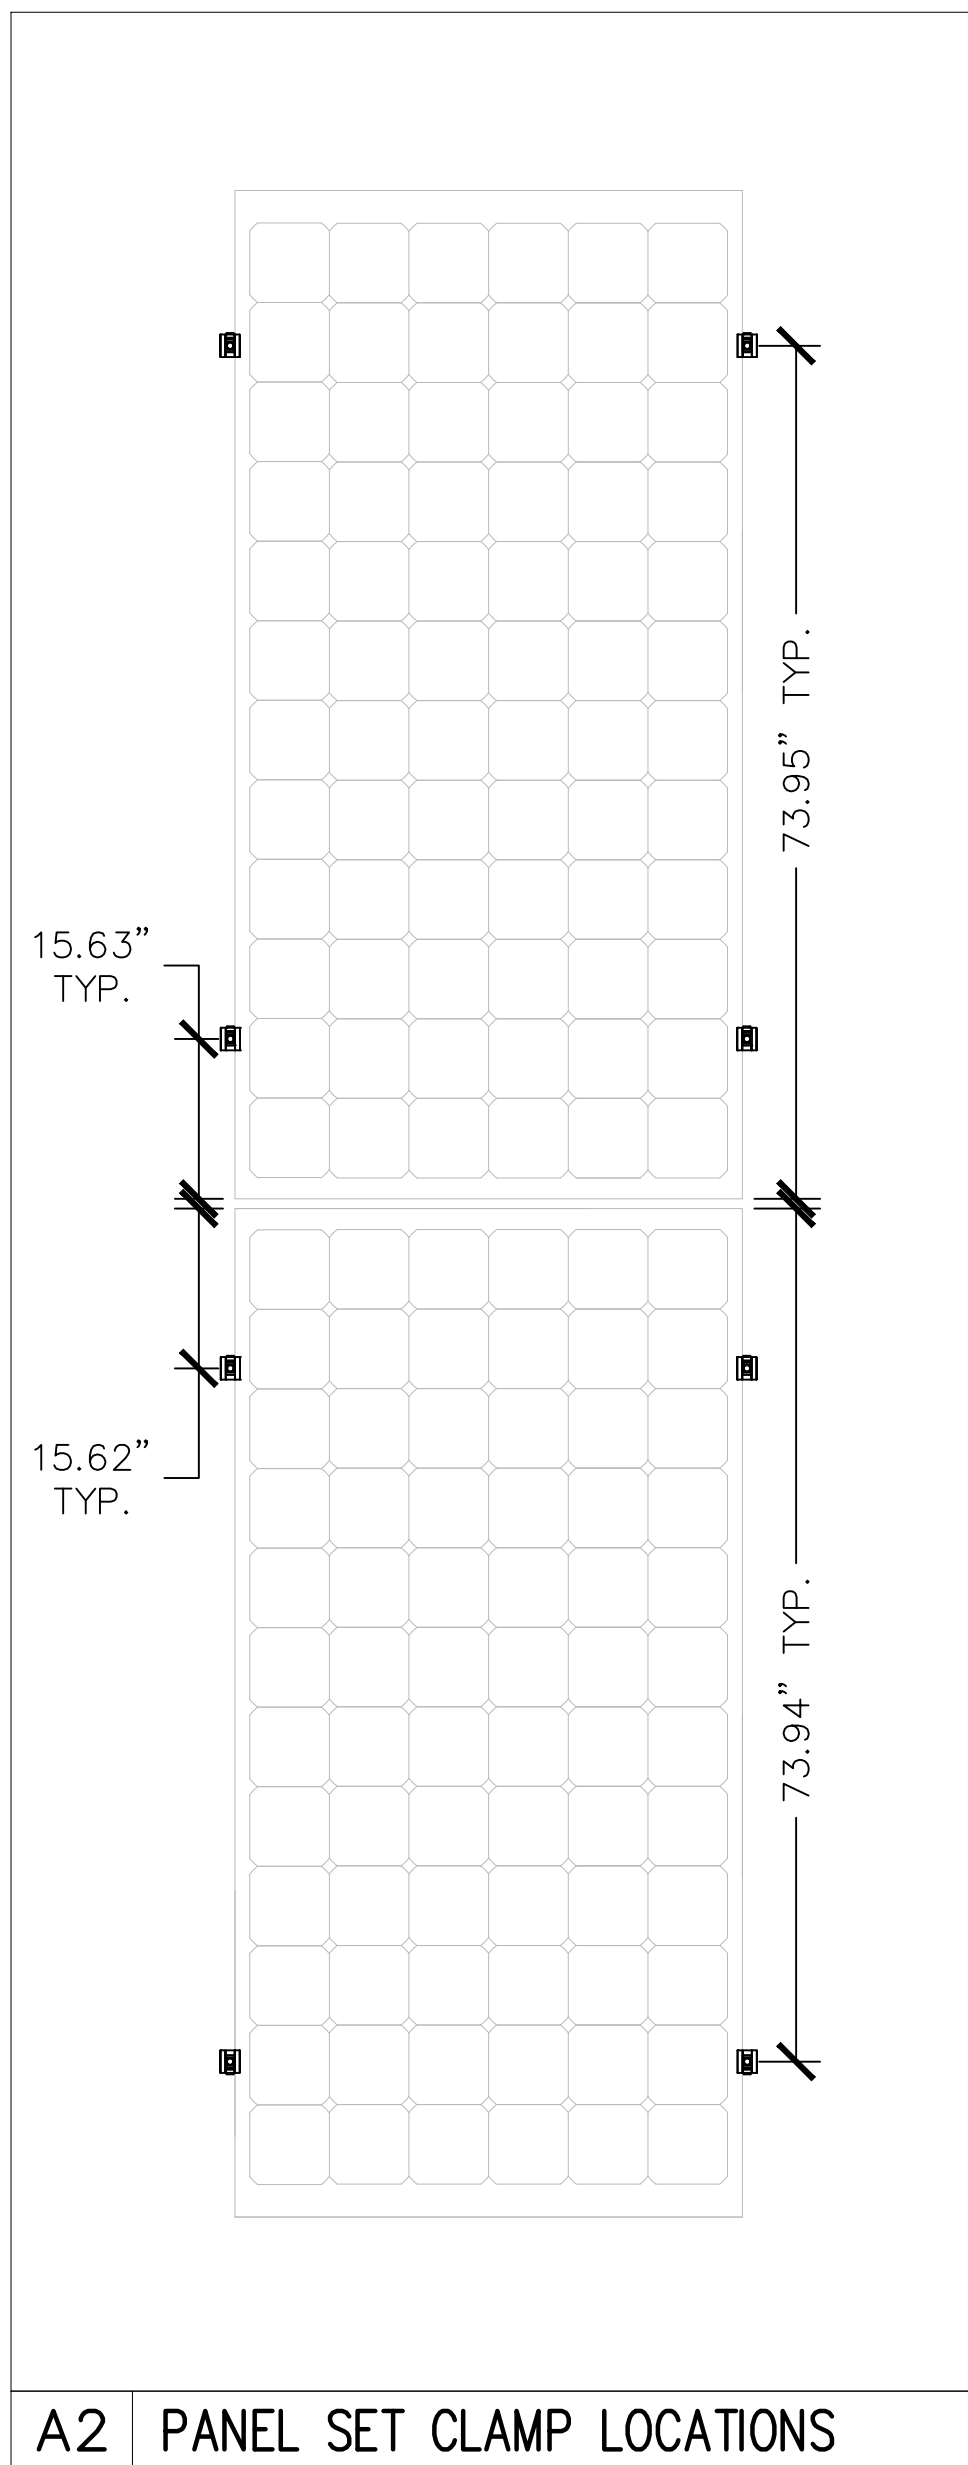


A2 PANEL SET CLAMP LOCATIONS

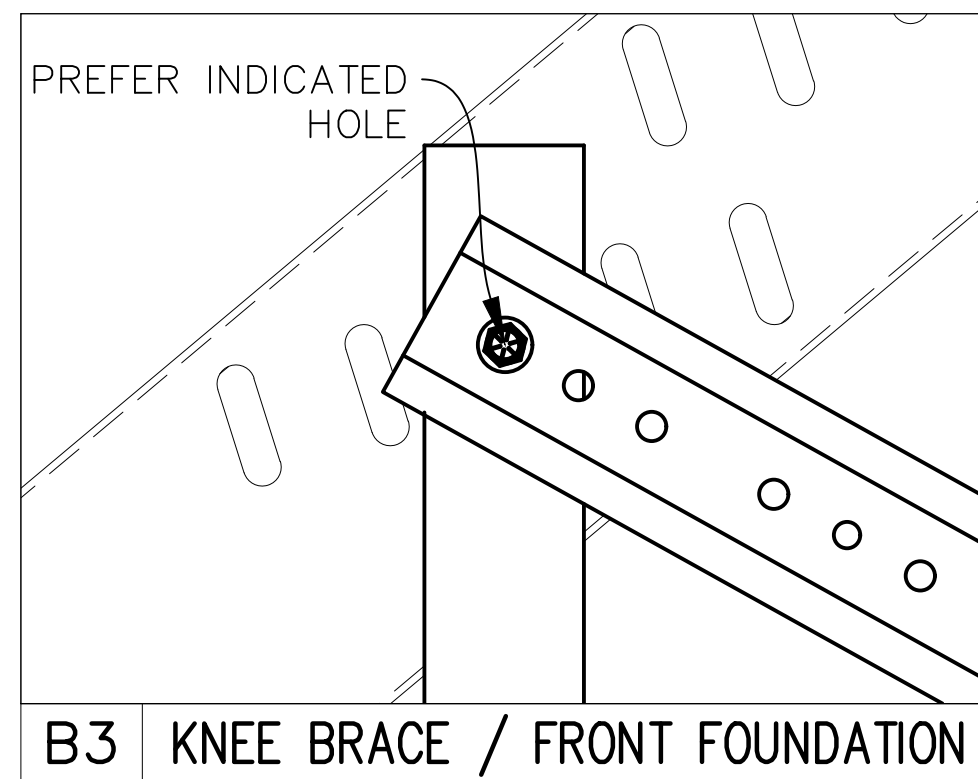

B3 KNEE BRACE / FRONT FOUNDATION

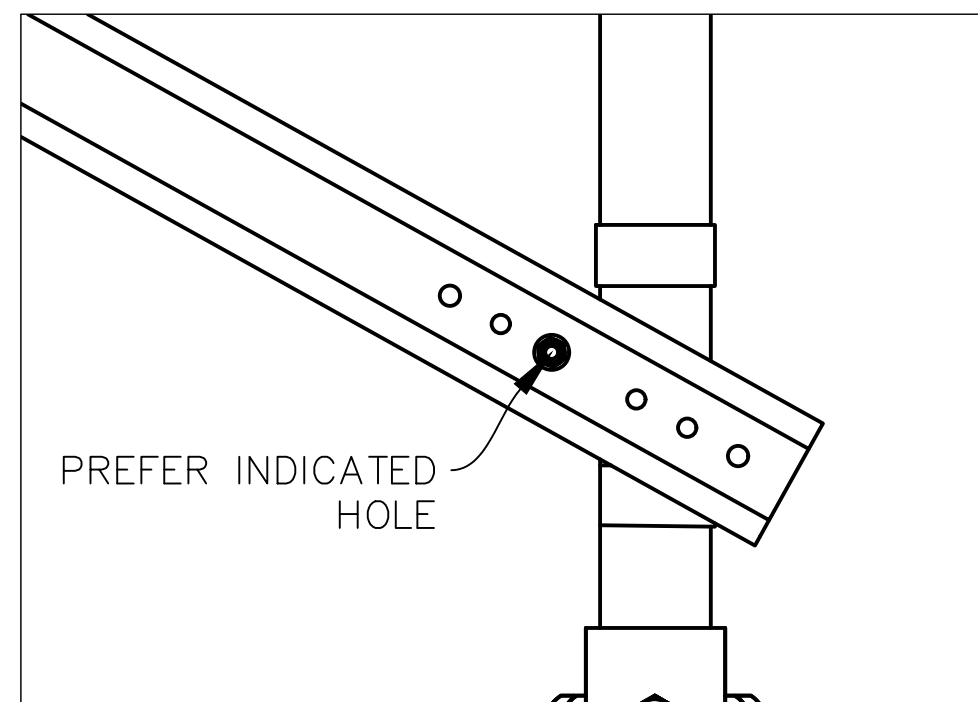


A3 KNEE BRACE / TUBE CLAMP HOLE

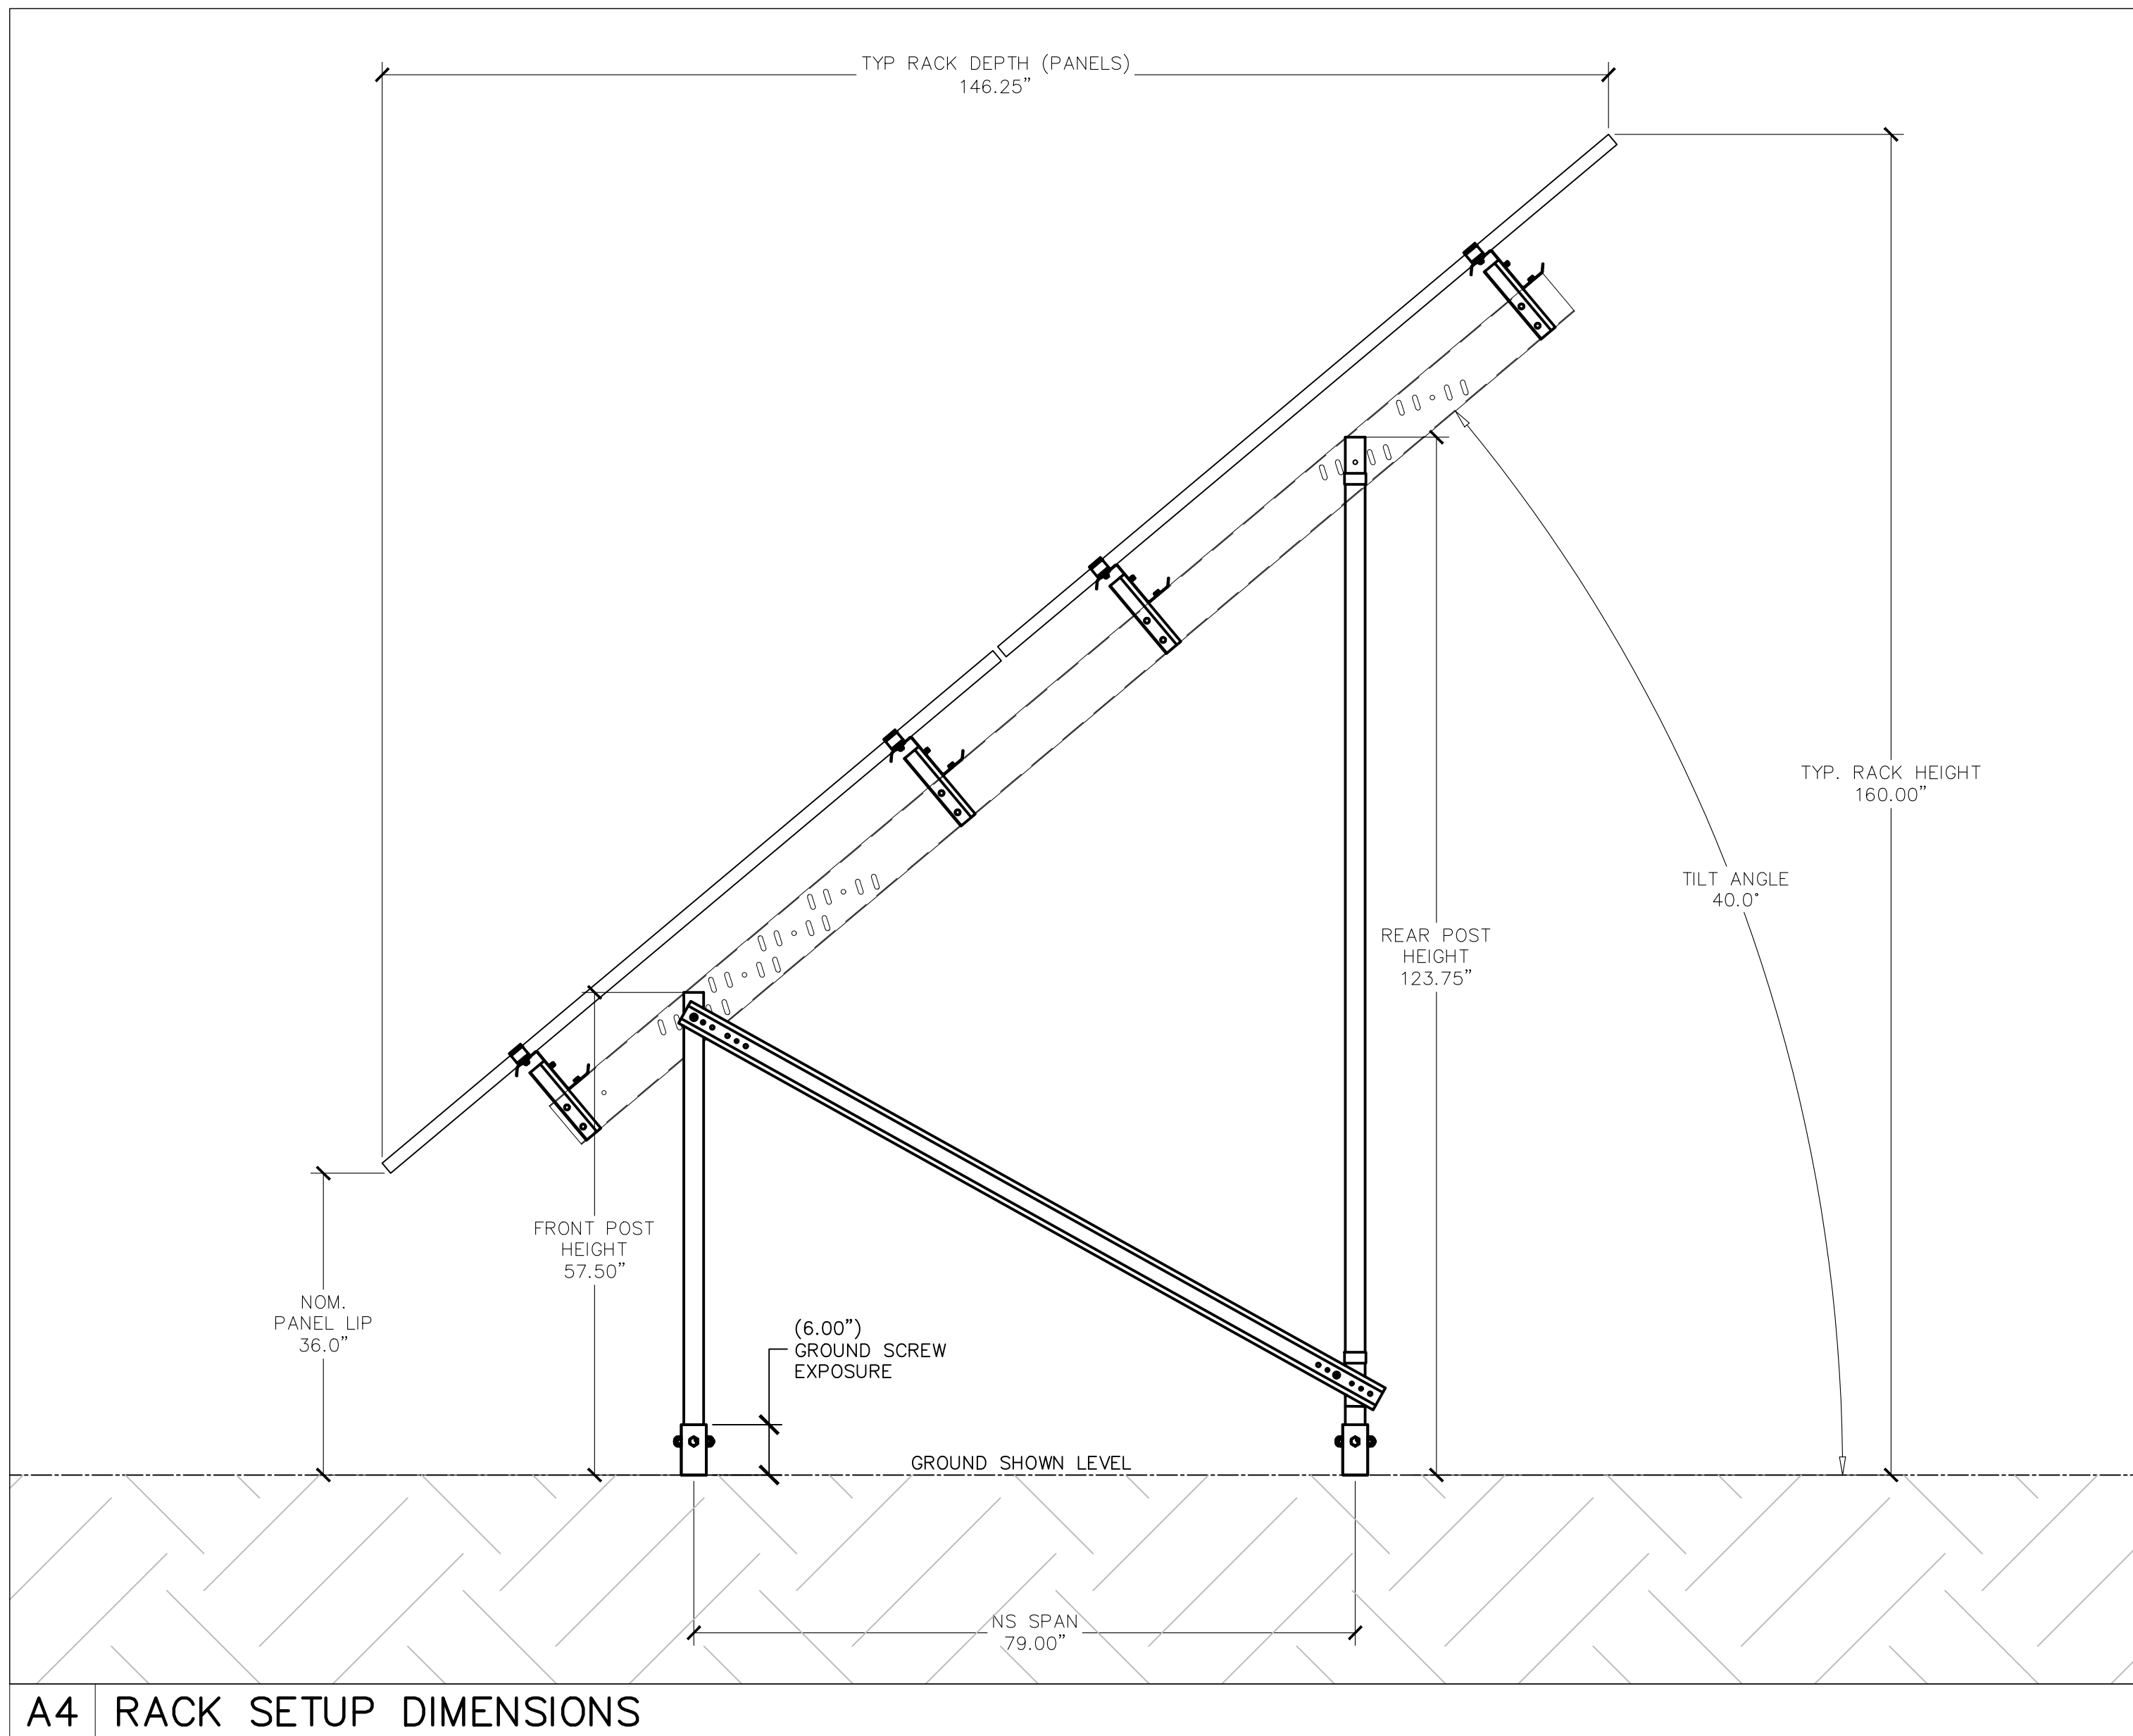

A4 RACK SETUP DIMENSIONS

CUSTOMER

 **Tanana Chiefs Conference**

TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER

 **APA SOLAR RACKING**

20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE

 **TITAN RACKING**

STRUCTURAL ENGINEER OF RECORD

 **the jdi group architects & engineers**

360 W. DUSSEL DR.  
MAUMEE, OH 43537  
(P) 419.725.7161 (F) 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME: **GALENA**

SITE ADDRESS: -----

SITE CITY, STATE: **GALENA, AK 99741**

SHEET REVISIONS

REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/16/2023

**APPROVED**

DRAWN: AB, REVIEWED: MR, APPROVED: JR, SIZE: D

SHEET NAME: **RACKING DIMENSIONS**

PROJECT NUMBER: **220925**

DRAWING NUMBER: **G-300**

REV. **A**

SCALE IS REDUCED WHEN SHEET SIZE IS 11" x 17"




D

C

B

A

1/20/2023 8:08:53 AM A005046 01/16/23 I:\projects\csl\new\220925\_gpmc\_sl\_gpmc\_micropyl\larsen\_chiefs\engineering\1\sls\larsen\220925\_gpmc\_sl\_gpmc\_micropyl\larsen\_chiefs\larsen\_chiefs\_rack.dwg

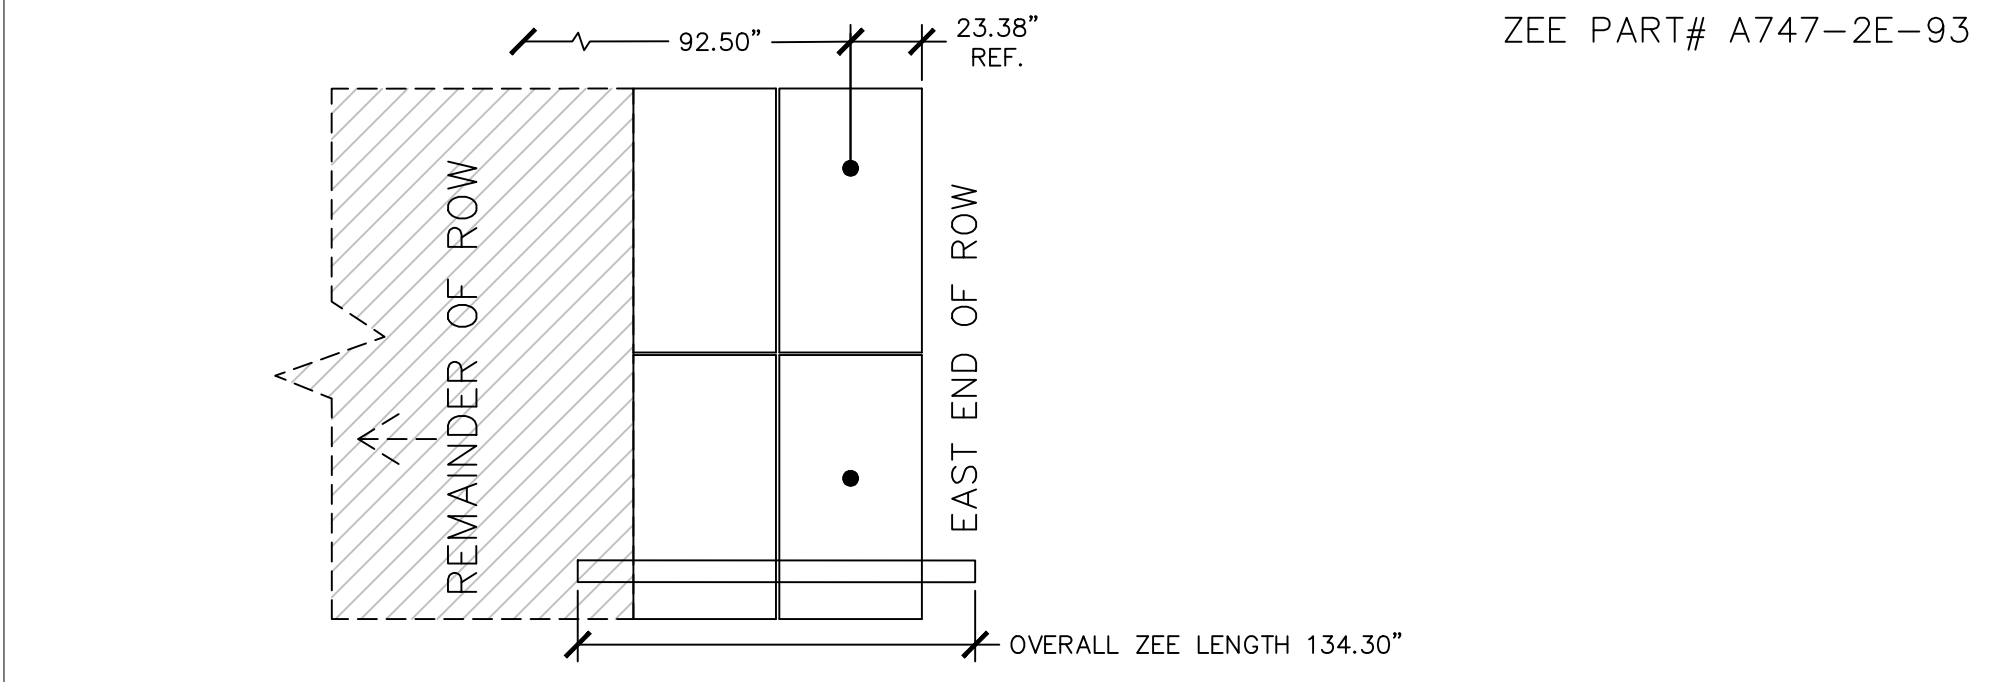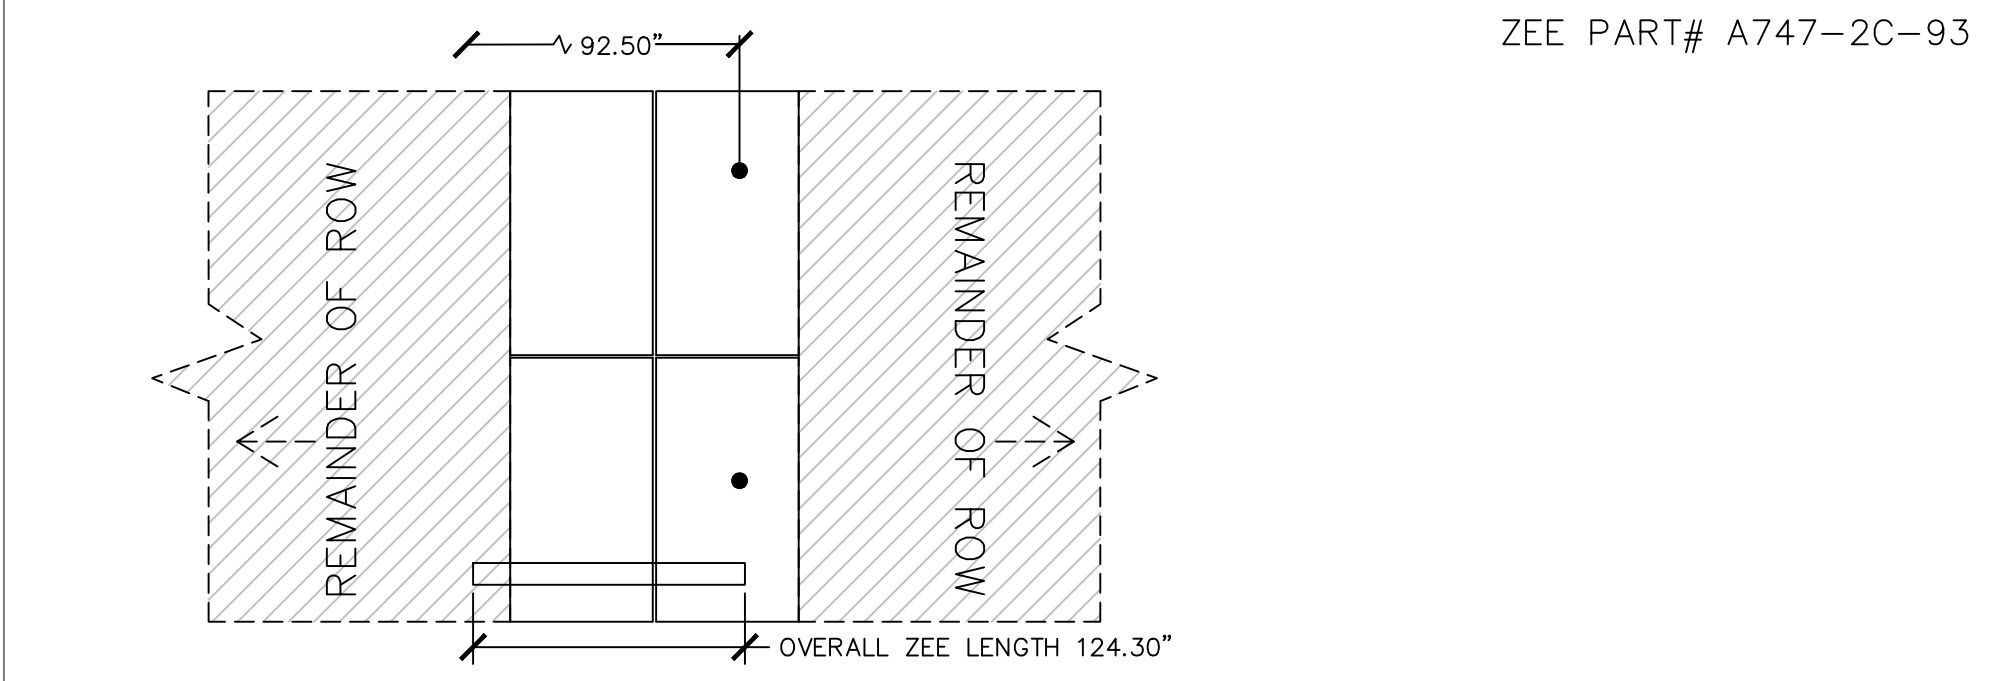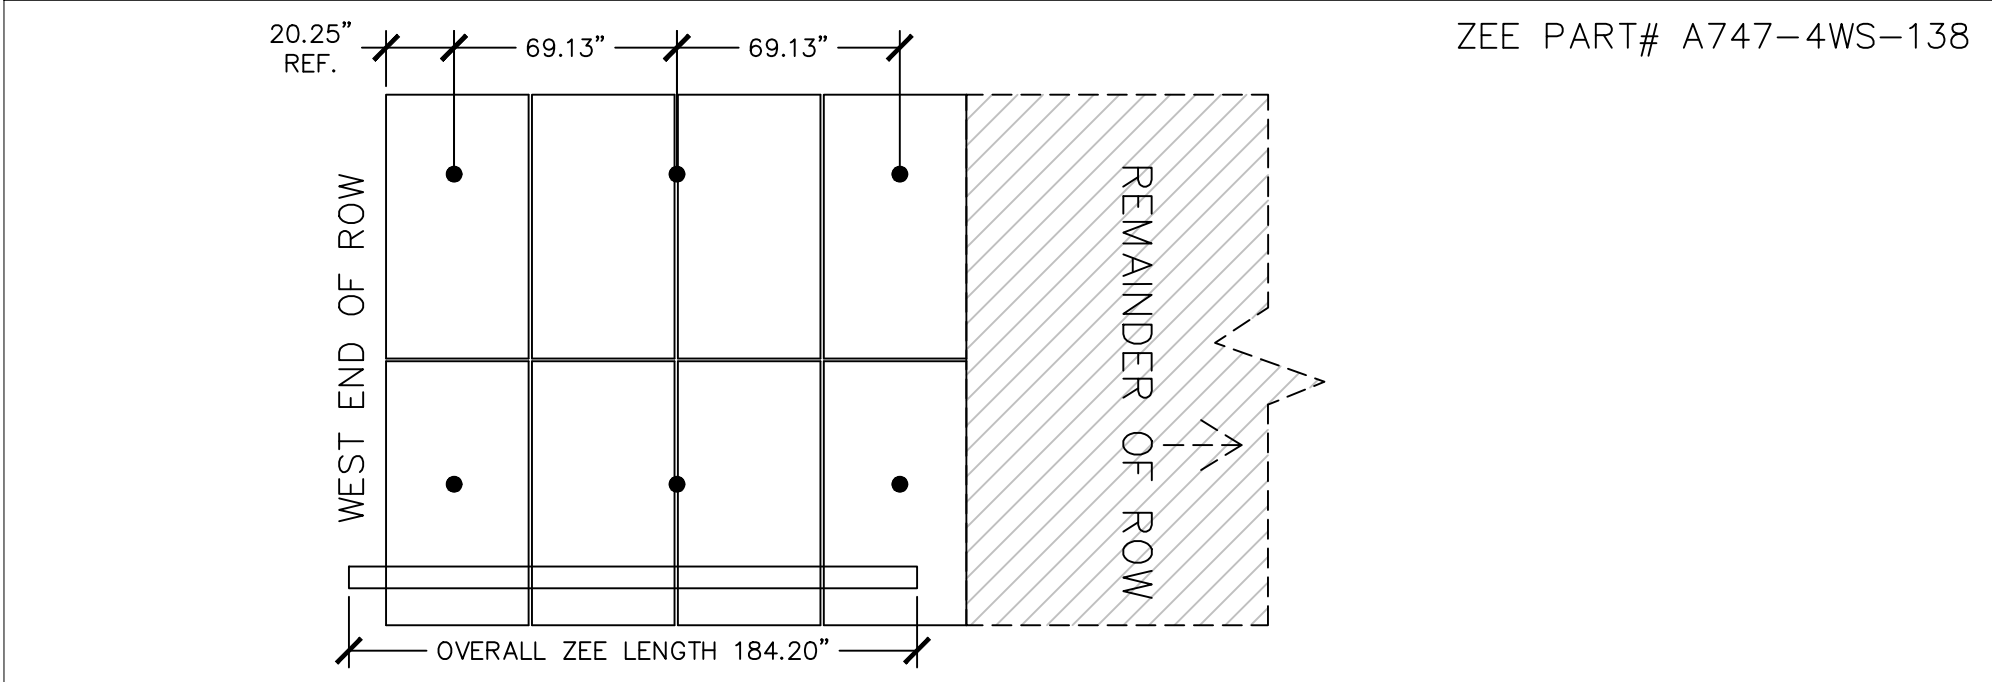

### NOTES

1. PLACE END CLAMPS AT ALL ZEE SPLICES.
2. TABLE NUMBERS INDICATE HOW MANY MODULE SETS ARE BETWEEN END CLAMPS.
3. THE TABLE NUMBER IS WITHIN THE ZEE PURLIN PART NUMBER.

REF.EXAMPLE: ZEE PART# A747-2C-93

TABLE NUMBER

### PROJECT BRACE DIMENSIONS

	SHORT E/W (SE69)	LONG E/W (SE93)
LENGTH	116.50"	131.25"
DIAMETER	1/8"	1/8"
PART #	A354-495	A354-510
COLOR CODE	YELLOW	RED
SPAN	69.13" E/W	92.50" E/W

1. E/W CROSS BRACING REAR FOUNDATIONS ONLY
2. BRACE ALL EW SPANS CROSSING CABLE BRACES.
3. PLACE KNEE BRACE BETWEEN EVERY NORTH-SOUTH FOUNDATION SPAN.
4. SEE ROW TECHNICAL DATA SHEETS L-150 AND BRACING PLAN L-500 FOR EXACT BRACING LOCATIONS.

### A4 BRACING LENGTHS/USEAGE

CUSTOMER



TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



STRUCTURAL ENGINEER OF RECORD



360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP





SITE NAME: GALENA  
SITE ADDRESS: ---  
SITE CITY, STATE: GALENA, AK 99741

SHEET REVISIONS		DATE
REV.	DESCRIPTION	
A	INITIAL RELEASE	2/16/2023

APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D
SHEET NAME			
RACKING DIMENSIONS			
PROJECT NUMBER			
220925			
DRAWING NUMBER		REV.	
G-301		A	

FOR 92.50”  
SPANS:  
ALIGN FRONT  
TRANSVERSE  
BRACE HOLE TO  
INDICATED HOLE  
ON THE ZEE.  
THEN ATTACH  
STRAPS TO THE  
HOLES 19.75”  
FROM THE  
INDICATED HOLE  
ON THE ZEE.  
THEN ATTACH  
BOTH STRAPS  
TO THE  
TRANSVERSE  
BRACE HOLE  
29.25” FROM  
THE FRONT  
TRANSVERSE  
BRACE HOLE.

<div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: center;">  <p><b>Tanana Chiefs Conference</b></p> </div> <div style="text-align: center;"> <p>TANANA CHIEFS 122 1ST AVE FAIRBANKS, AK 99701 (P) 907-452-8251</p> </div> </div>			
<p><b>RACKING PROVIDER</b></p> <div style="text-align: center;">  <p><b>20-345 COUNTY ROAD X RIDGEVILLE CORNERS, OH 43555</b> (P) 419.267.5280 (F) 419.267.5214 WWW.APALTERNATIVES.COM</p> </div>			
<p><b>RACKING TYPE</b></p> <div style="text-align: center;">  <p><b>STRUCTURAL ENGINEER OF RECORD</b></p> <div style="text-align: center;">  <p><b>architects &amp; engineers</b></p> <p>360 W. DUSSEL DR. MAUMEE, OH 43537 ☎ 419.725.7161 ☐ 419.725.7160</p> </div> </div>			
<p><b>PROFESSIONAL SEAL/STAMP</b></p>			

SITE NAME:	<h1 style="margin: 0;">GALENA</h1>	SITE ADDRESS:	<p>--- --</p>
SITE CITY-STATE:	<h1 style="margin: 0;">GALENA, AK 99741</h1>		

<b>SHEET REVISIONS</b>		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	10/17/2016

## APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D

SHEET NAME


4-RAIL TRANSVERSE  
BRACE: 92.50"  
SPANS

PROJECT NUMBER

220925

DRAWING NUMBER	REV.
G-302	A



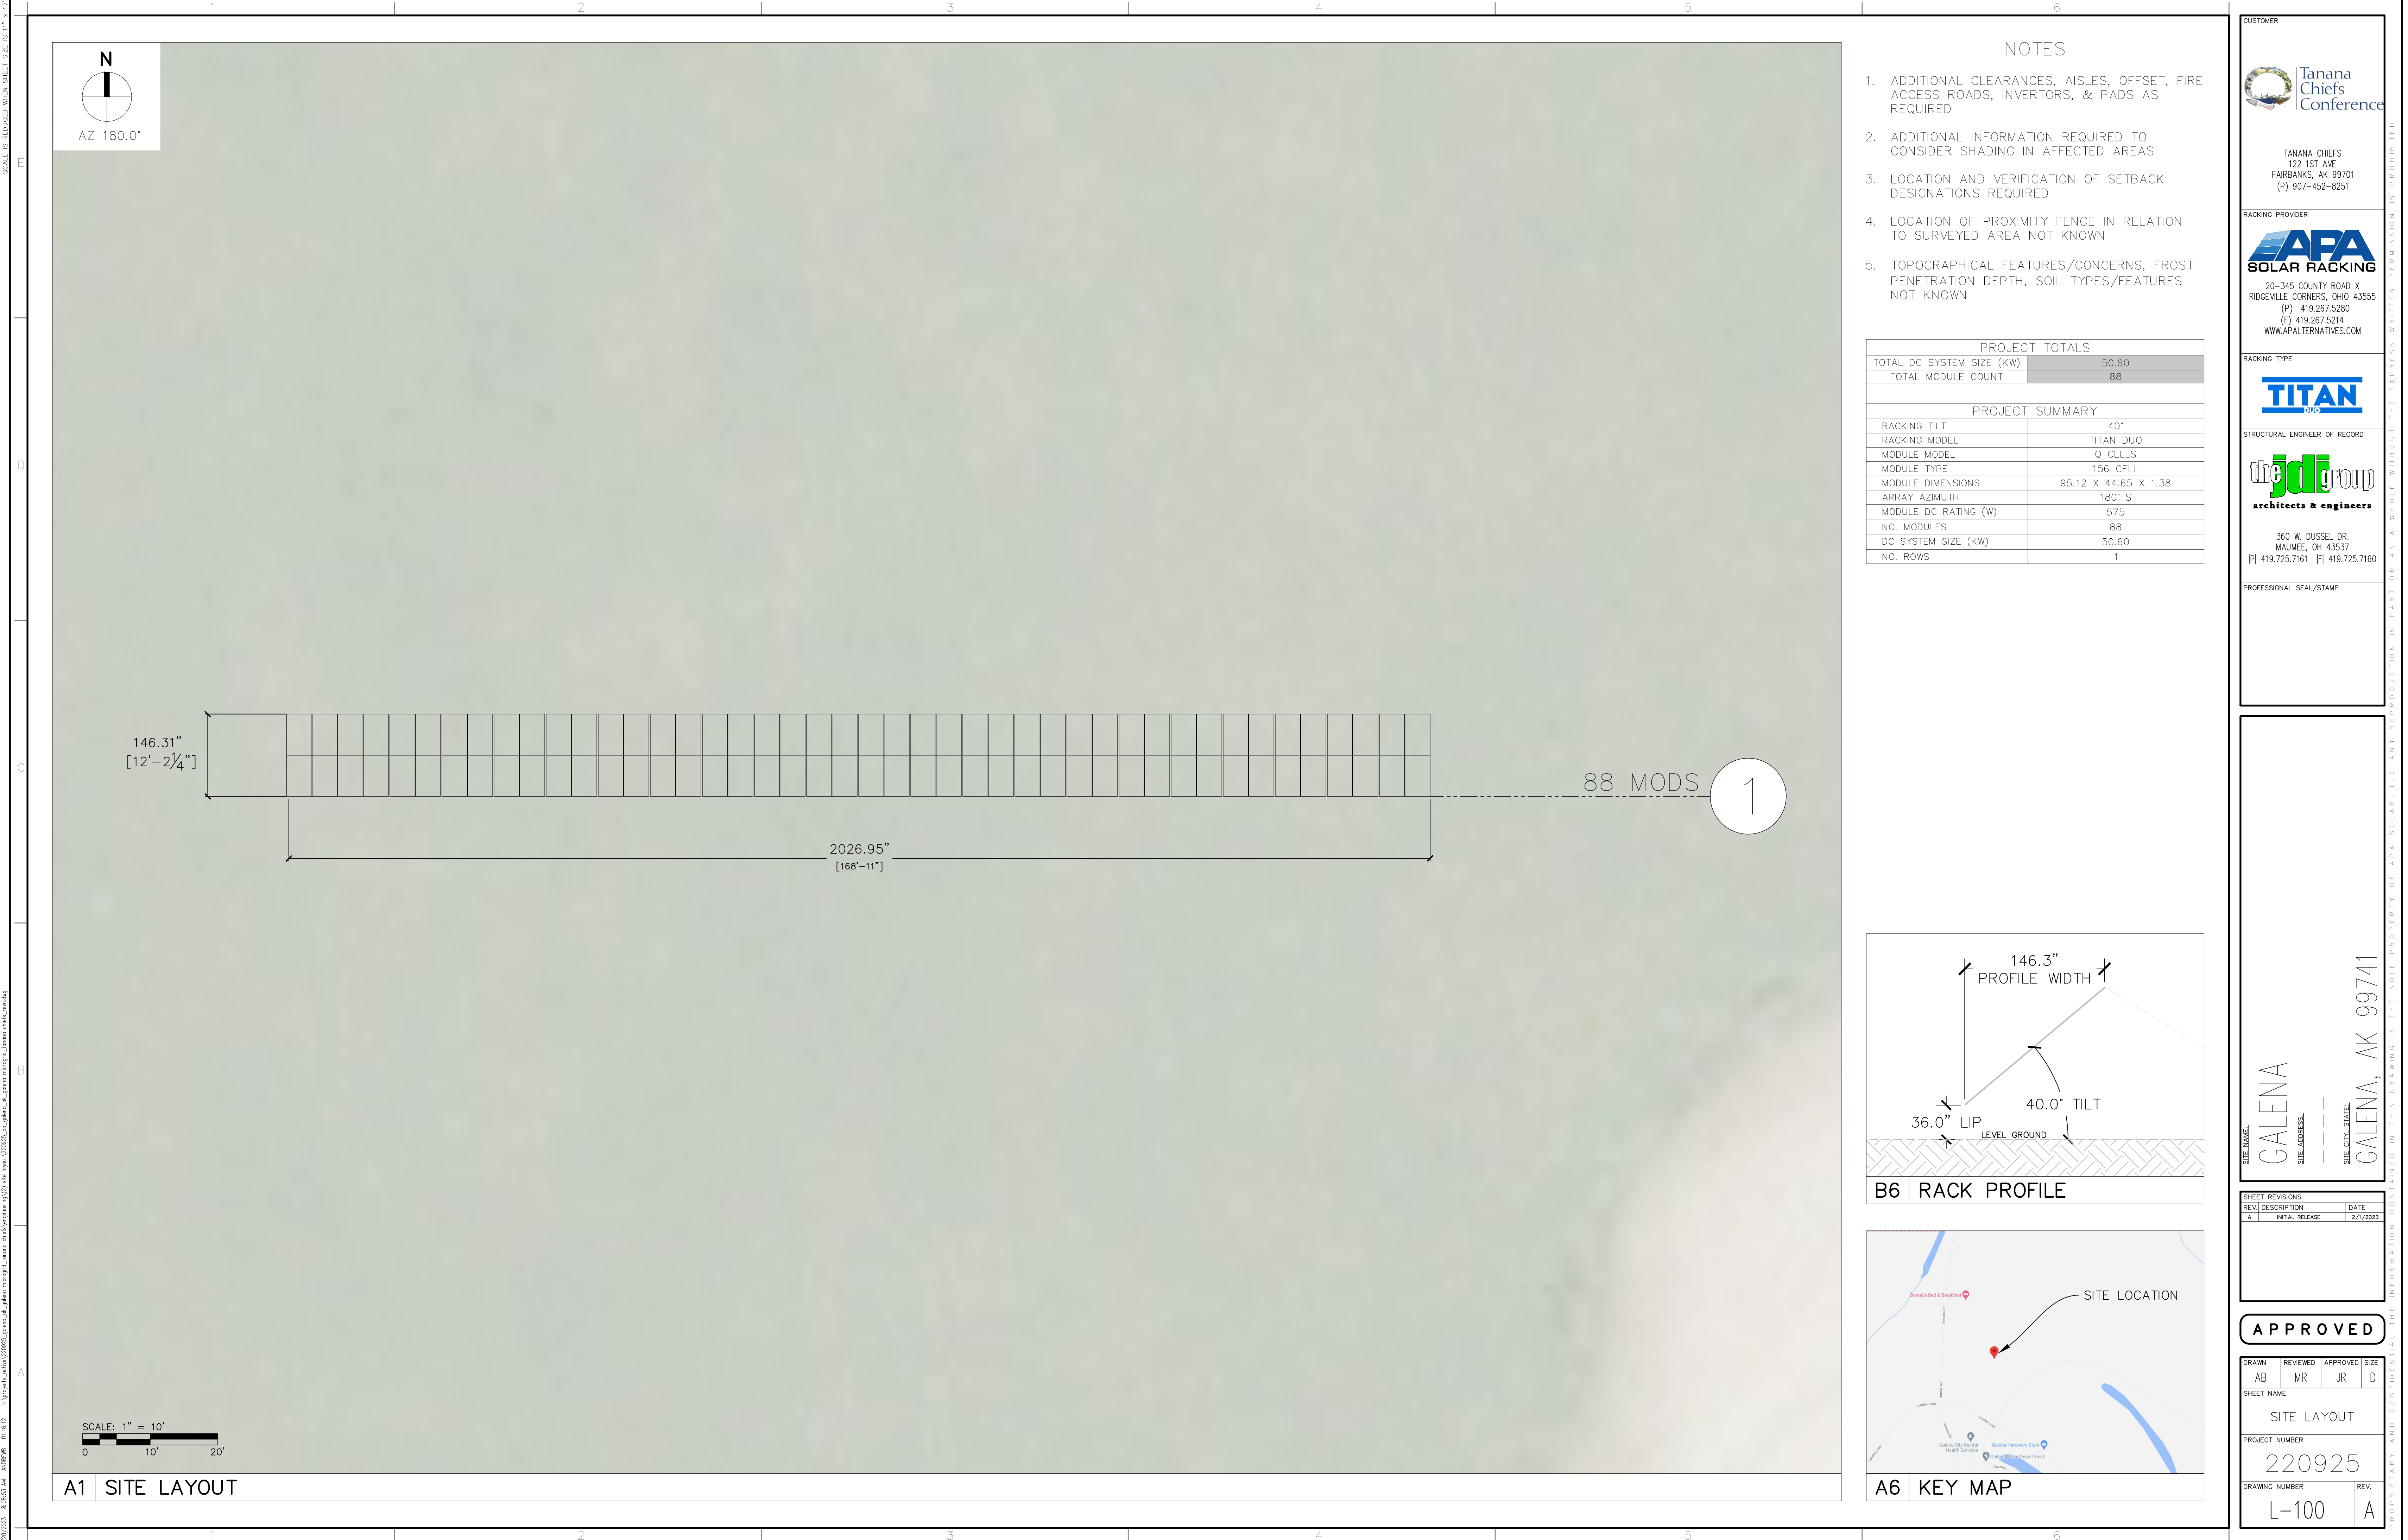


NOTES


1. ADDITIONAL CLEARANCES, AISLES, OFFSET, FIRE ACCESS ROADS, INVERTORS, & PADS AS REQUIRED
2. ADDITIONAL INFORMATION REQUIRED TO CONSIDER SHADING IN AFFECTED AREAS
3. LOCATION AND VERIFICATION OF SETBACK DESIGNATIONS REQUIRED
4. LOCATION OF PROXIMITY FENCE IN RELATION TO SURVEYED AREA NOT KNOWN
5. TOPOGRAPHICAL FEATURES/CONCERNS, FROST PENETRATION DEPTH, SOIL TYPES/FEATURES NOT KNOWN

PROJECT TOTALS	
TOTAL DC SYSTEM SIZE (KW)	50.60
TOTAL MODULE COUNT	88

PROJECT SUMMARY	
RACKING TILT	40°
RACKING MODEL	TITAN DUO
MODULE MODEL	Q CELLS
MODULE TYPE	156 CELL
MODULE DIMENSIONS	95.12 X 44.65 X 1.38
ARRAY AZIMUTH	180° S
MODULE DC RATING (W)	575
NO. MODULES	88
DC SYSTEM SIZE (KW)	50.60
NO. ROWS	1

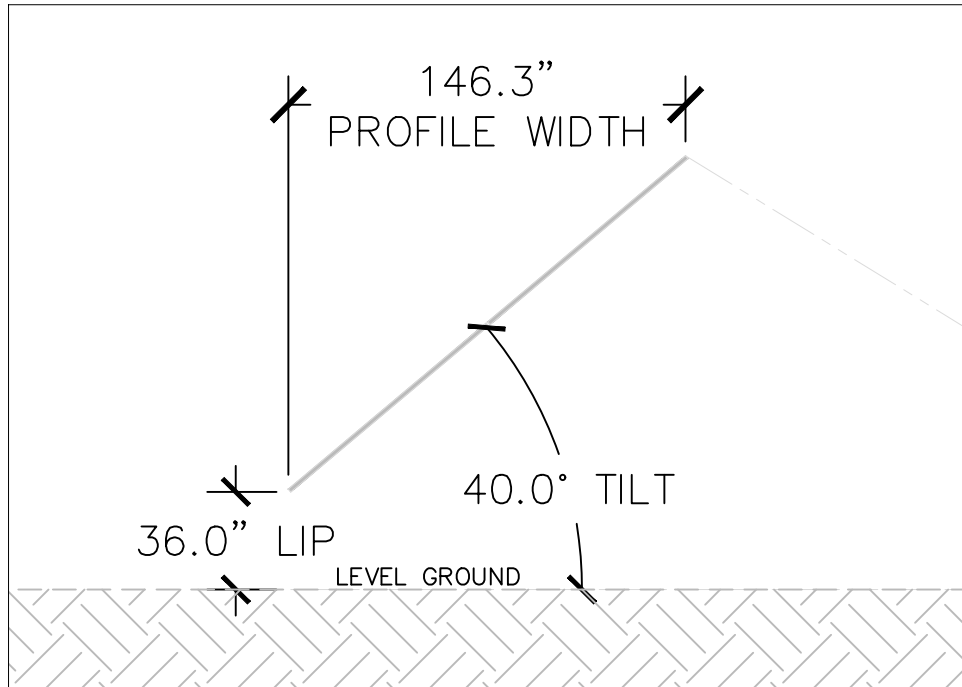

B6 RACK PROFILE

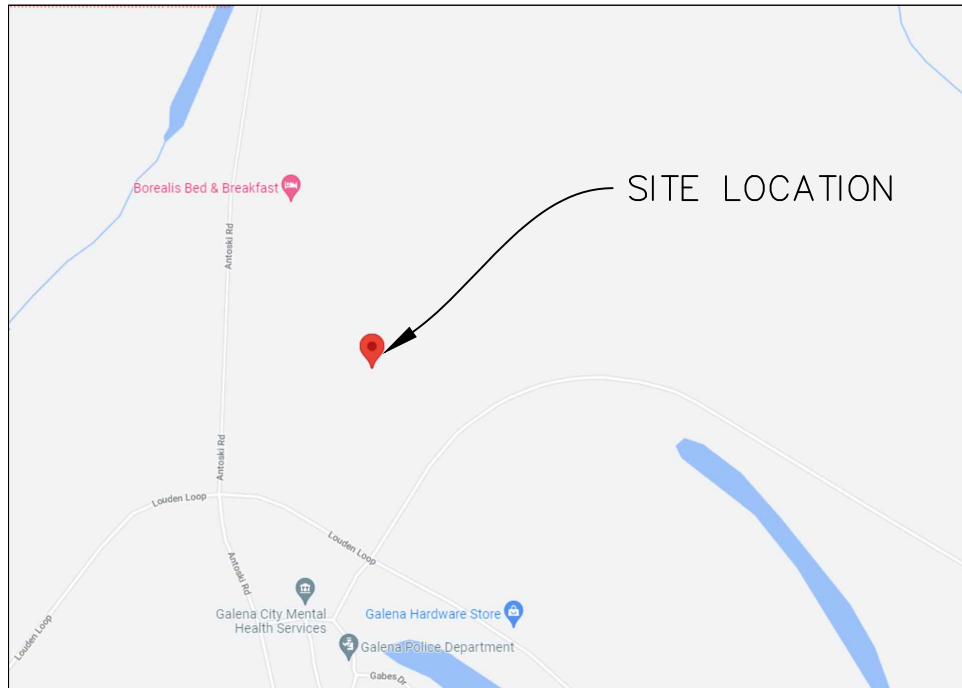

A6 KEY MAP

CUSTOMER



Tanana  
Chiefs  
Conference

TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



APA  
SOLAR RACKING

20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



TITAN  
DUO

STRUCTURAL ENGINEER OF RECORD



the **jdj** group  
architects & engineers

360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME:  
GALENA

SITE ADDRESS:  
-----

SITE CITY, STATE:  
GALENA, AK 99741

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/1/2023

APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D

SHEET NAME  
SITE LAYOUT


PROJECT NUMBER  
220925

DRAWING NUMBER  
L-100

REV.  
A



1  
2  
3  
4  
5  
6  
SCALE IS REDUCED WHEN SHEET SIZE IS 11" x 17"  
D  
C  
B  
A  
1  
2  
3  
4  
5  
6

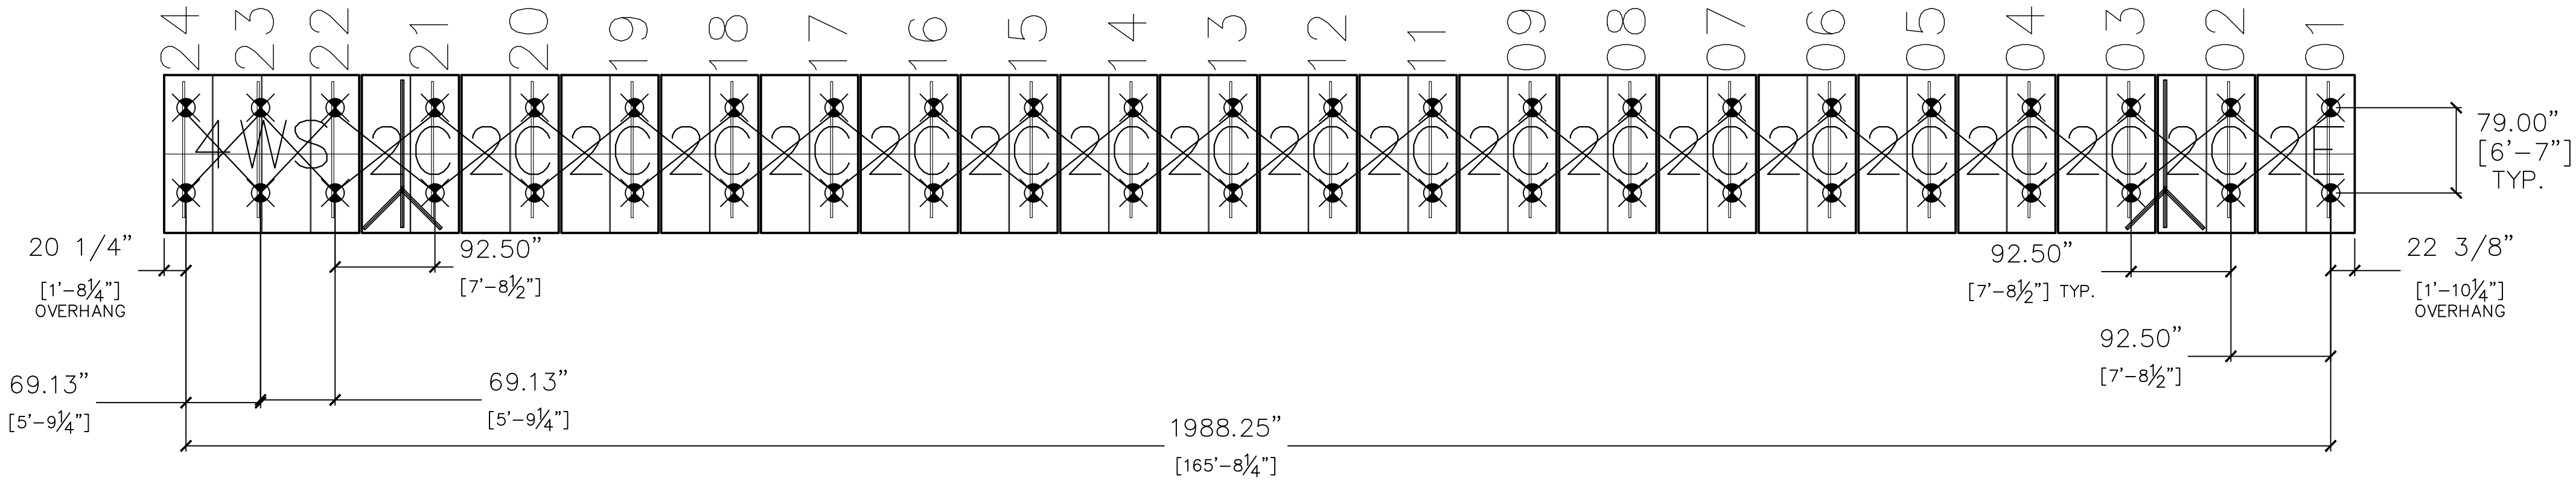

C1 88 MODULE ROW KEY / ROWS: 1

ROW BILL OF MATERIALS - TITAN		88 MODS
ROW	1	
EAST - WEST ZEE RAILS	4	
PV MODULES	88	
FOUNDATION SETS	24	
KNEE BRACE	24	
TRANSVERSE BRACE	2	
CABLE BRACE SHORT 69.13"	4	
CABLE BRACE LONG 92.50"	40	
EAST - WEST ZEE RAILS	4	MODS PER
A747-4W-134	4	8
A747-4C-178	76	4
A747-3C-134	4	4



Tanana  
Chiefs  
Conference

TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251



APA  
SOLAR RACKING

20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM



TITAN

RACKING TYPE



the id group  
architects & engineers

STRUCTURAL ENGINEER OF RECORD

360 W. DUSSEL DR.  
MAUMEE, OH 43537  
(P) 419.725.7161 (F) 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME:  
GALENA


SITE ADDRESS:  
-----

SITE CITY, STATE:  
GALENA, AK 99741

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/16/2023

APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D
SHEET NAME			
ROW TECHNICAL DATA			
PROJECT NUMBER			
220925			
DRAWING NUMBER		REV.	
L-150		A	

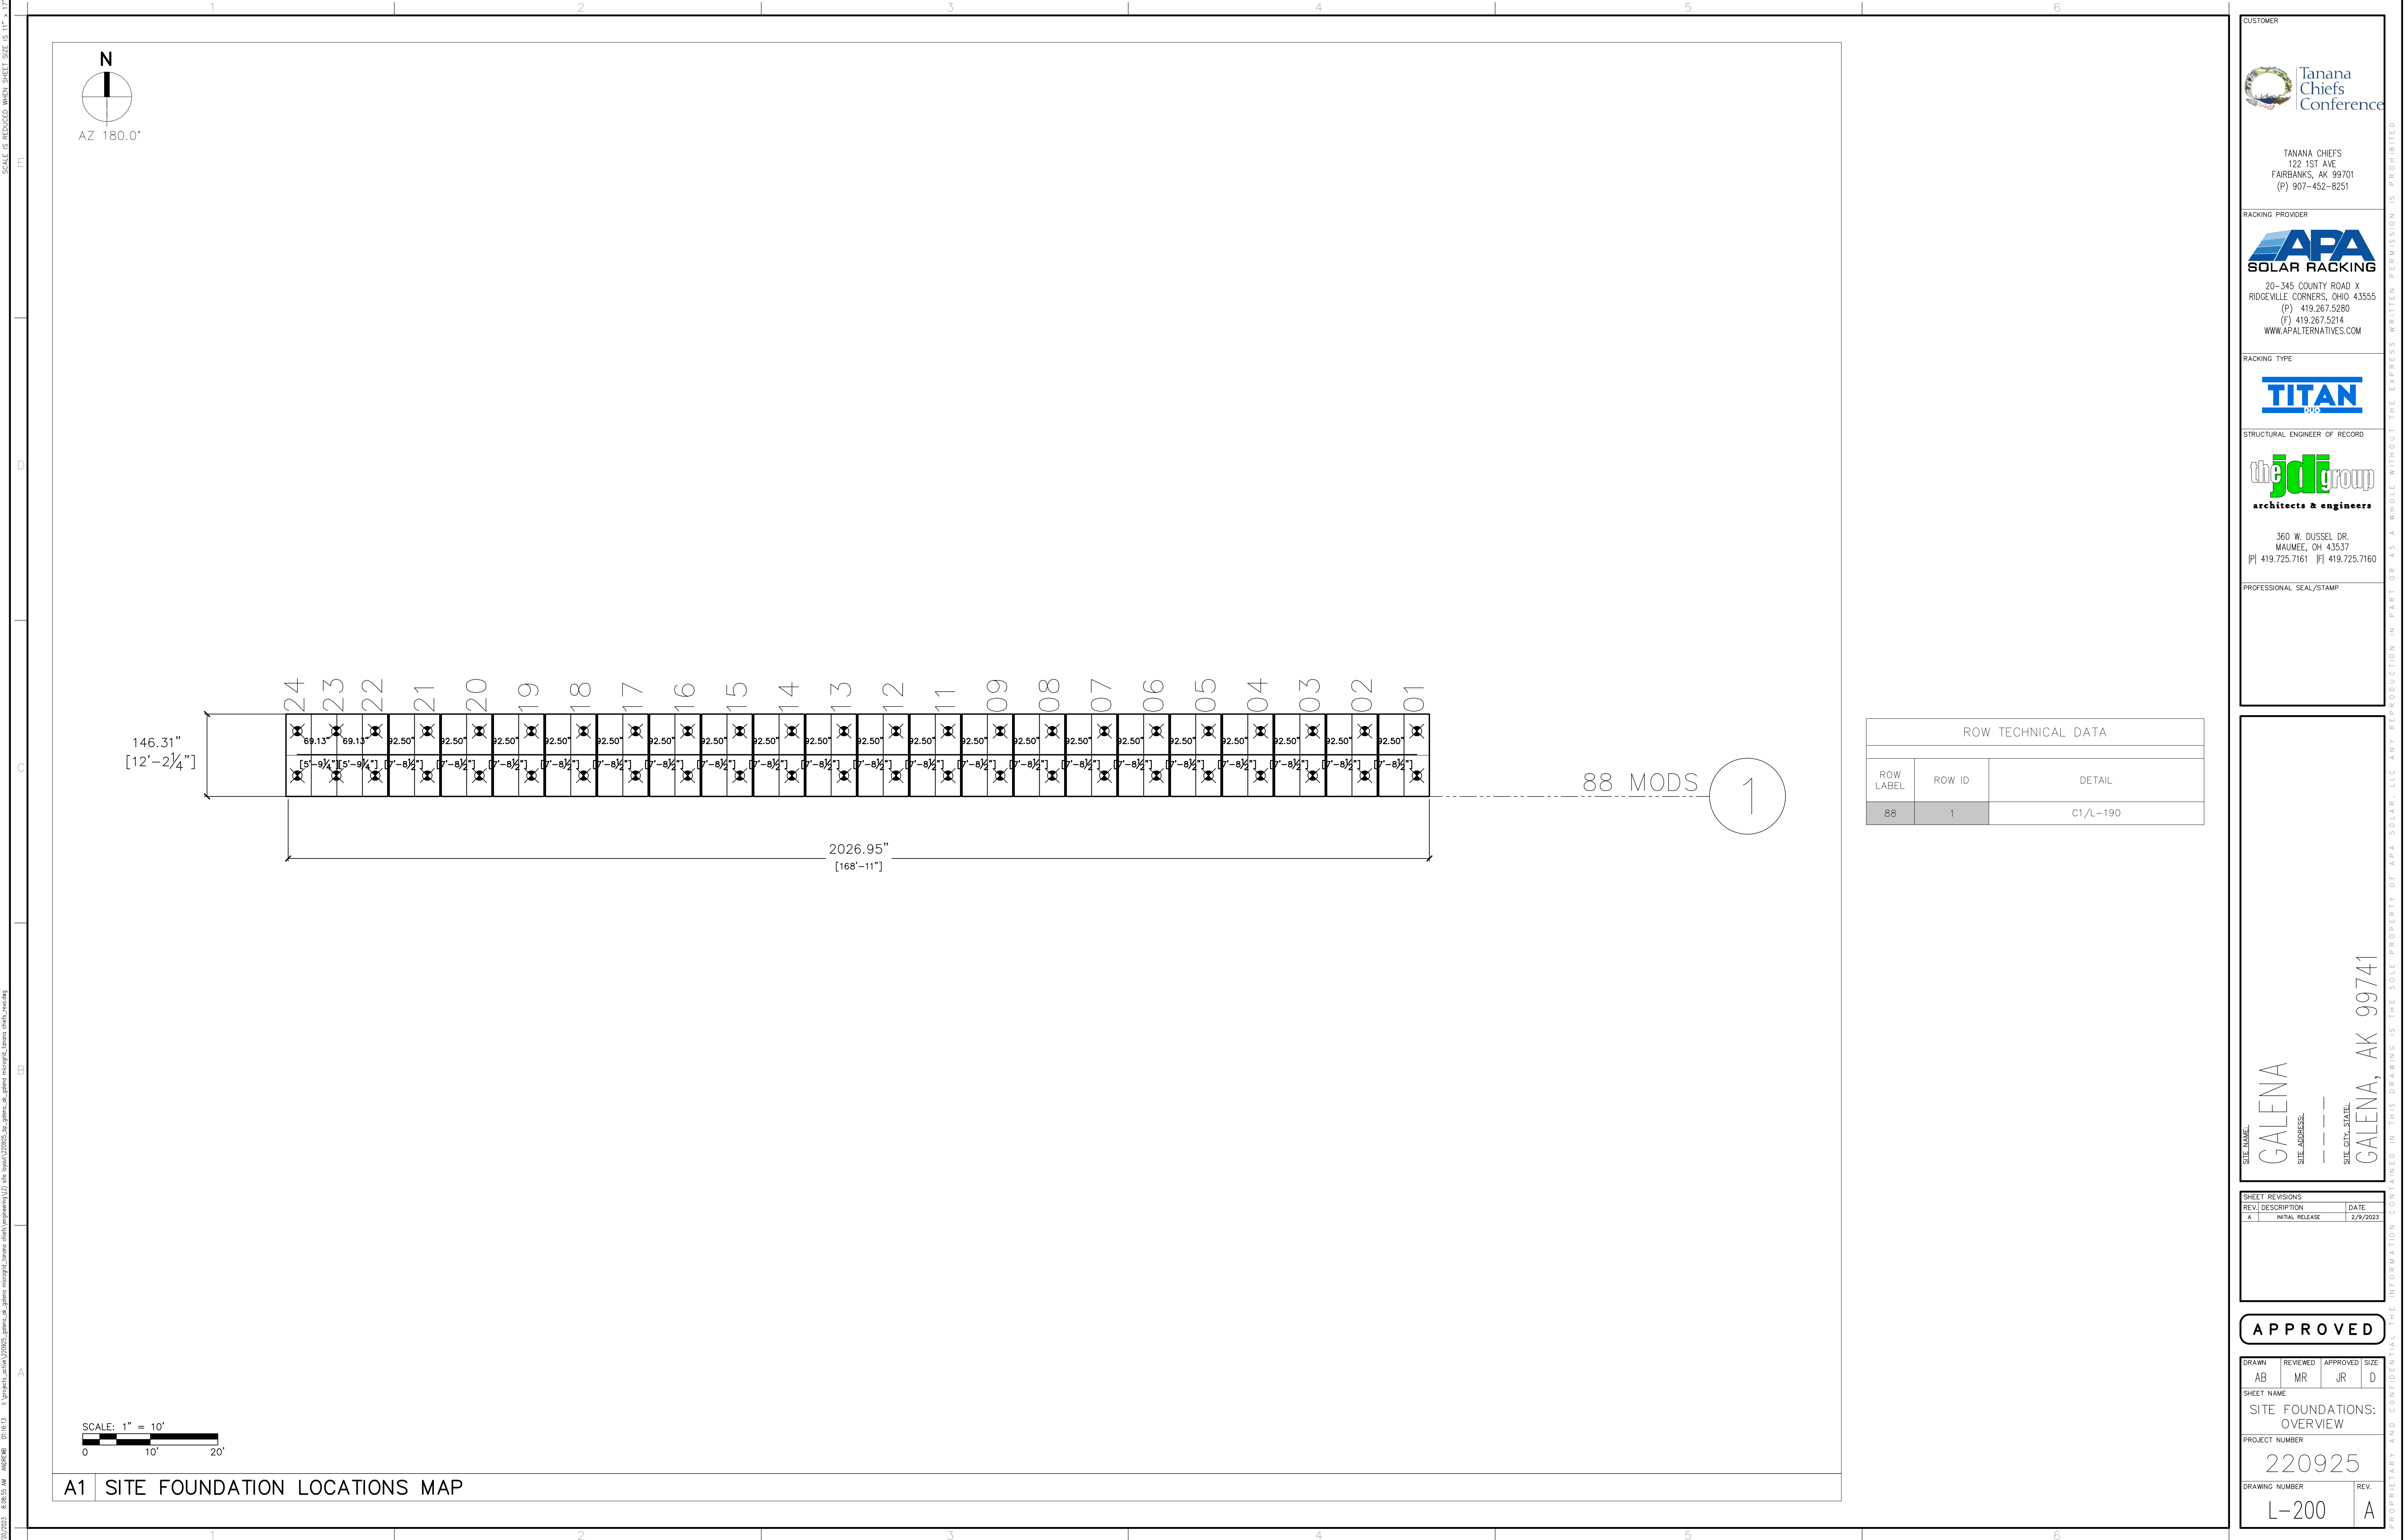

A1 SITE FOUNDATION LOCATIONS MAP

ROW TECHNICAL DATA		
ROW LABEL	ROW ID	DETAIL
88	1	C1/L-190

CUSTOMER



Tanana  
Chiefs  
Conference

TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



APA  
SOLAR RACKING

20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



TITAN  
RACKING

STRUCTURAL ENGINEER OF RECORD



the  
jdi  
group  
architects & engineers

360 W. DUSSEL DR.  
MAUMEE, OH 43537  
(P) 419.725.7161 (F) 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME:

GALENA

SITE ADDRESS:

---


SITE CITY, STATE:

GALENA, AK 99741

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/9/2023

APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D
SHEET NAME			
SITE FOUNDATIONS: OVERVIEW			
PROJECT NUMBER			
220925			
DRAWING NUMBER			REV.
L-200			A

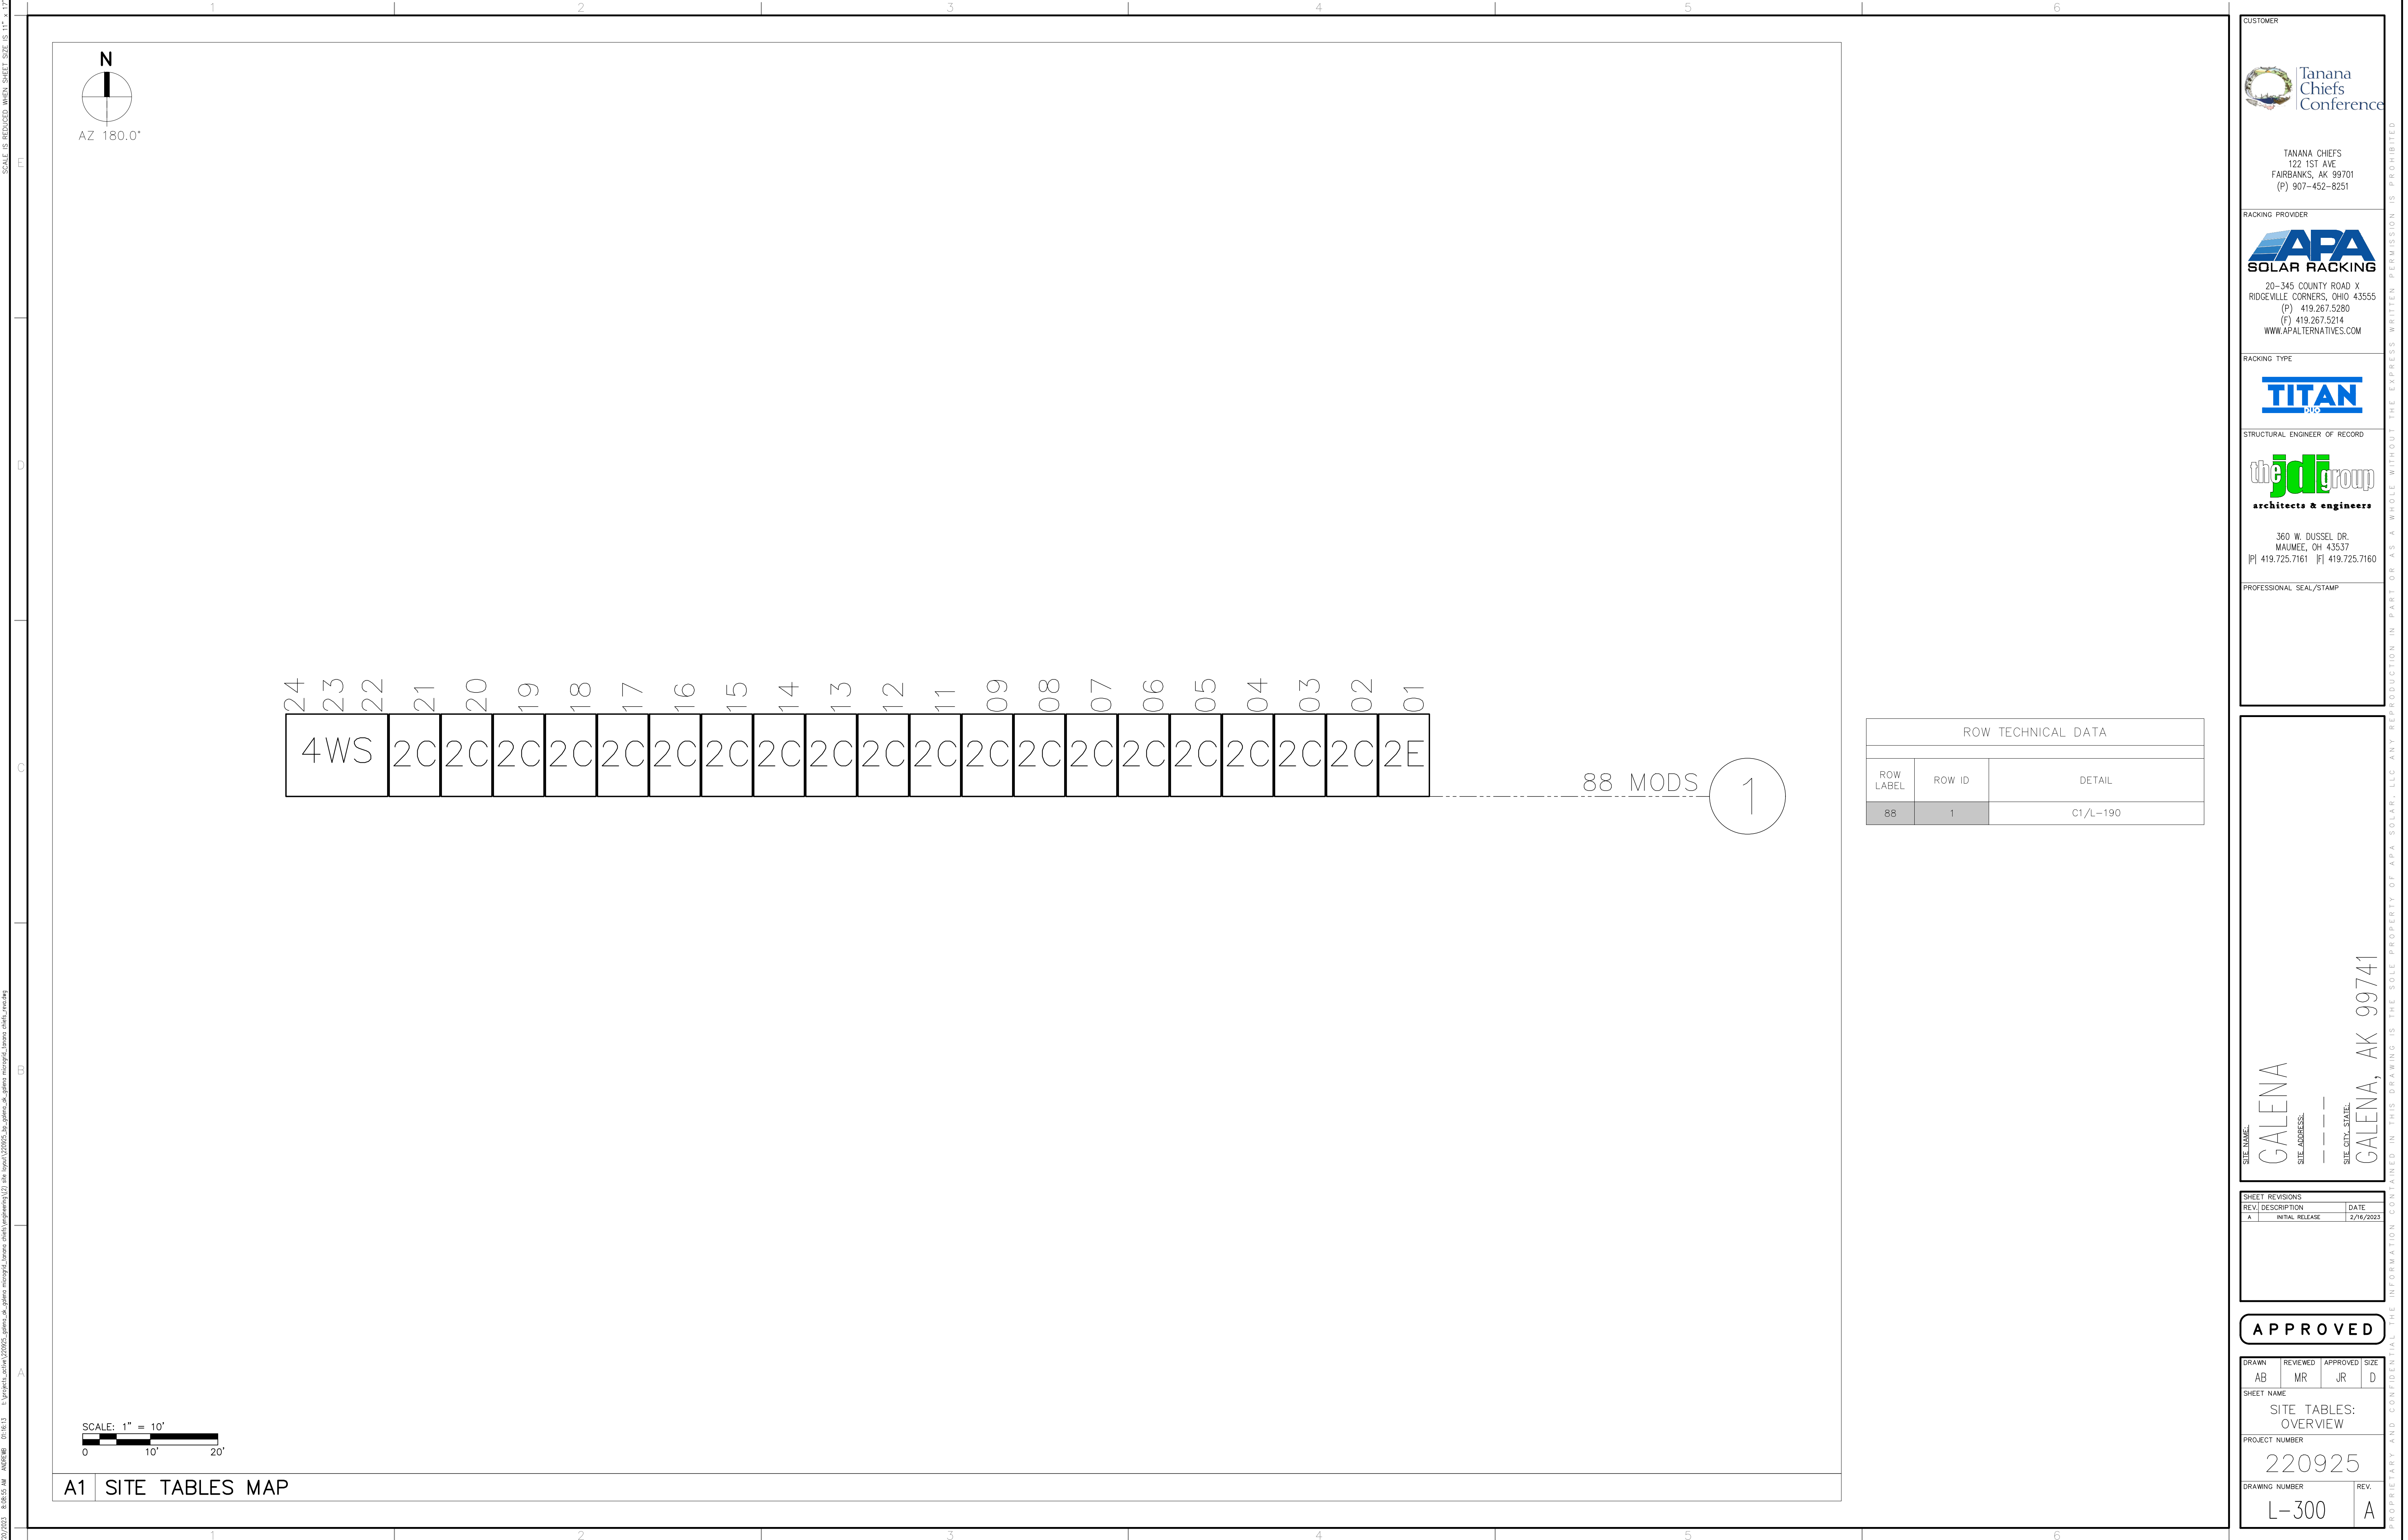

A1 SITE TABLES MAP

ROW TECHNICAL DATA		
ROW LABEL	ROW ID	DETAIL
88	1	C1/L-190

CUSTOMER



TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



STRUCTURAL ENGINEER OF RECORD



360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME:  
GALENA

SITE ADDRESS:  
-----


SITE CITY, STATE:  
GALENA, AK 99741

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/16/2023

APPROVED

DRAWN	REVIEWED	APPROVED	SIZE
AB	MR	JR	D
SHEET NAME SITE TABLES: OVERVIEW			
PROJECT NUMBER 220925			
DRAWING NUMBER L-300			REV. A

2/16/2023 8:08:53 AM A005046 01:02:13 I:\projects\active\220925\_galena.ak\_galena\_micropyl\_tanana\_chiefs\_conference\21 site layout\220925\_site\_galena\_micropyl\_tanana\_chiefs\_conference.dwg

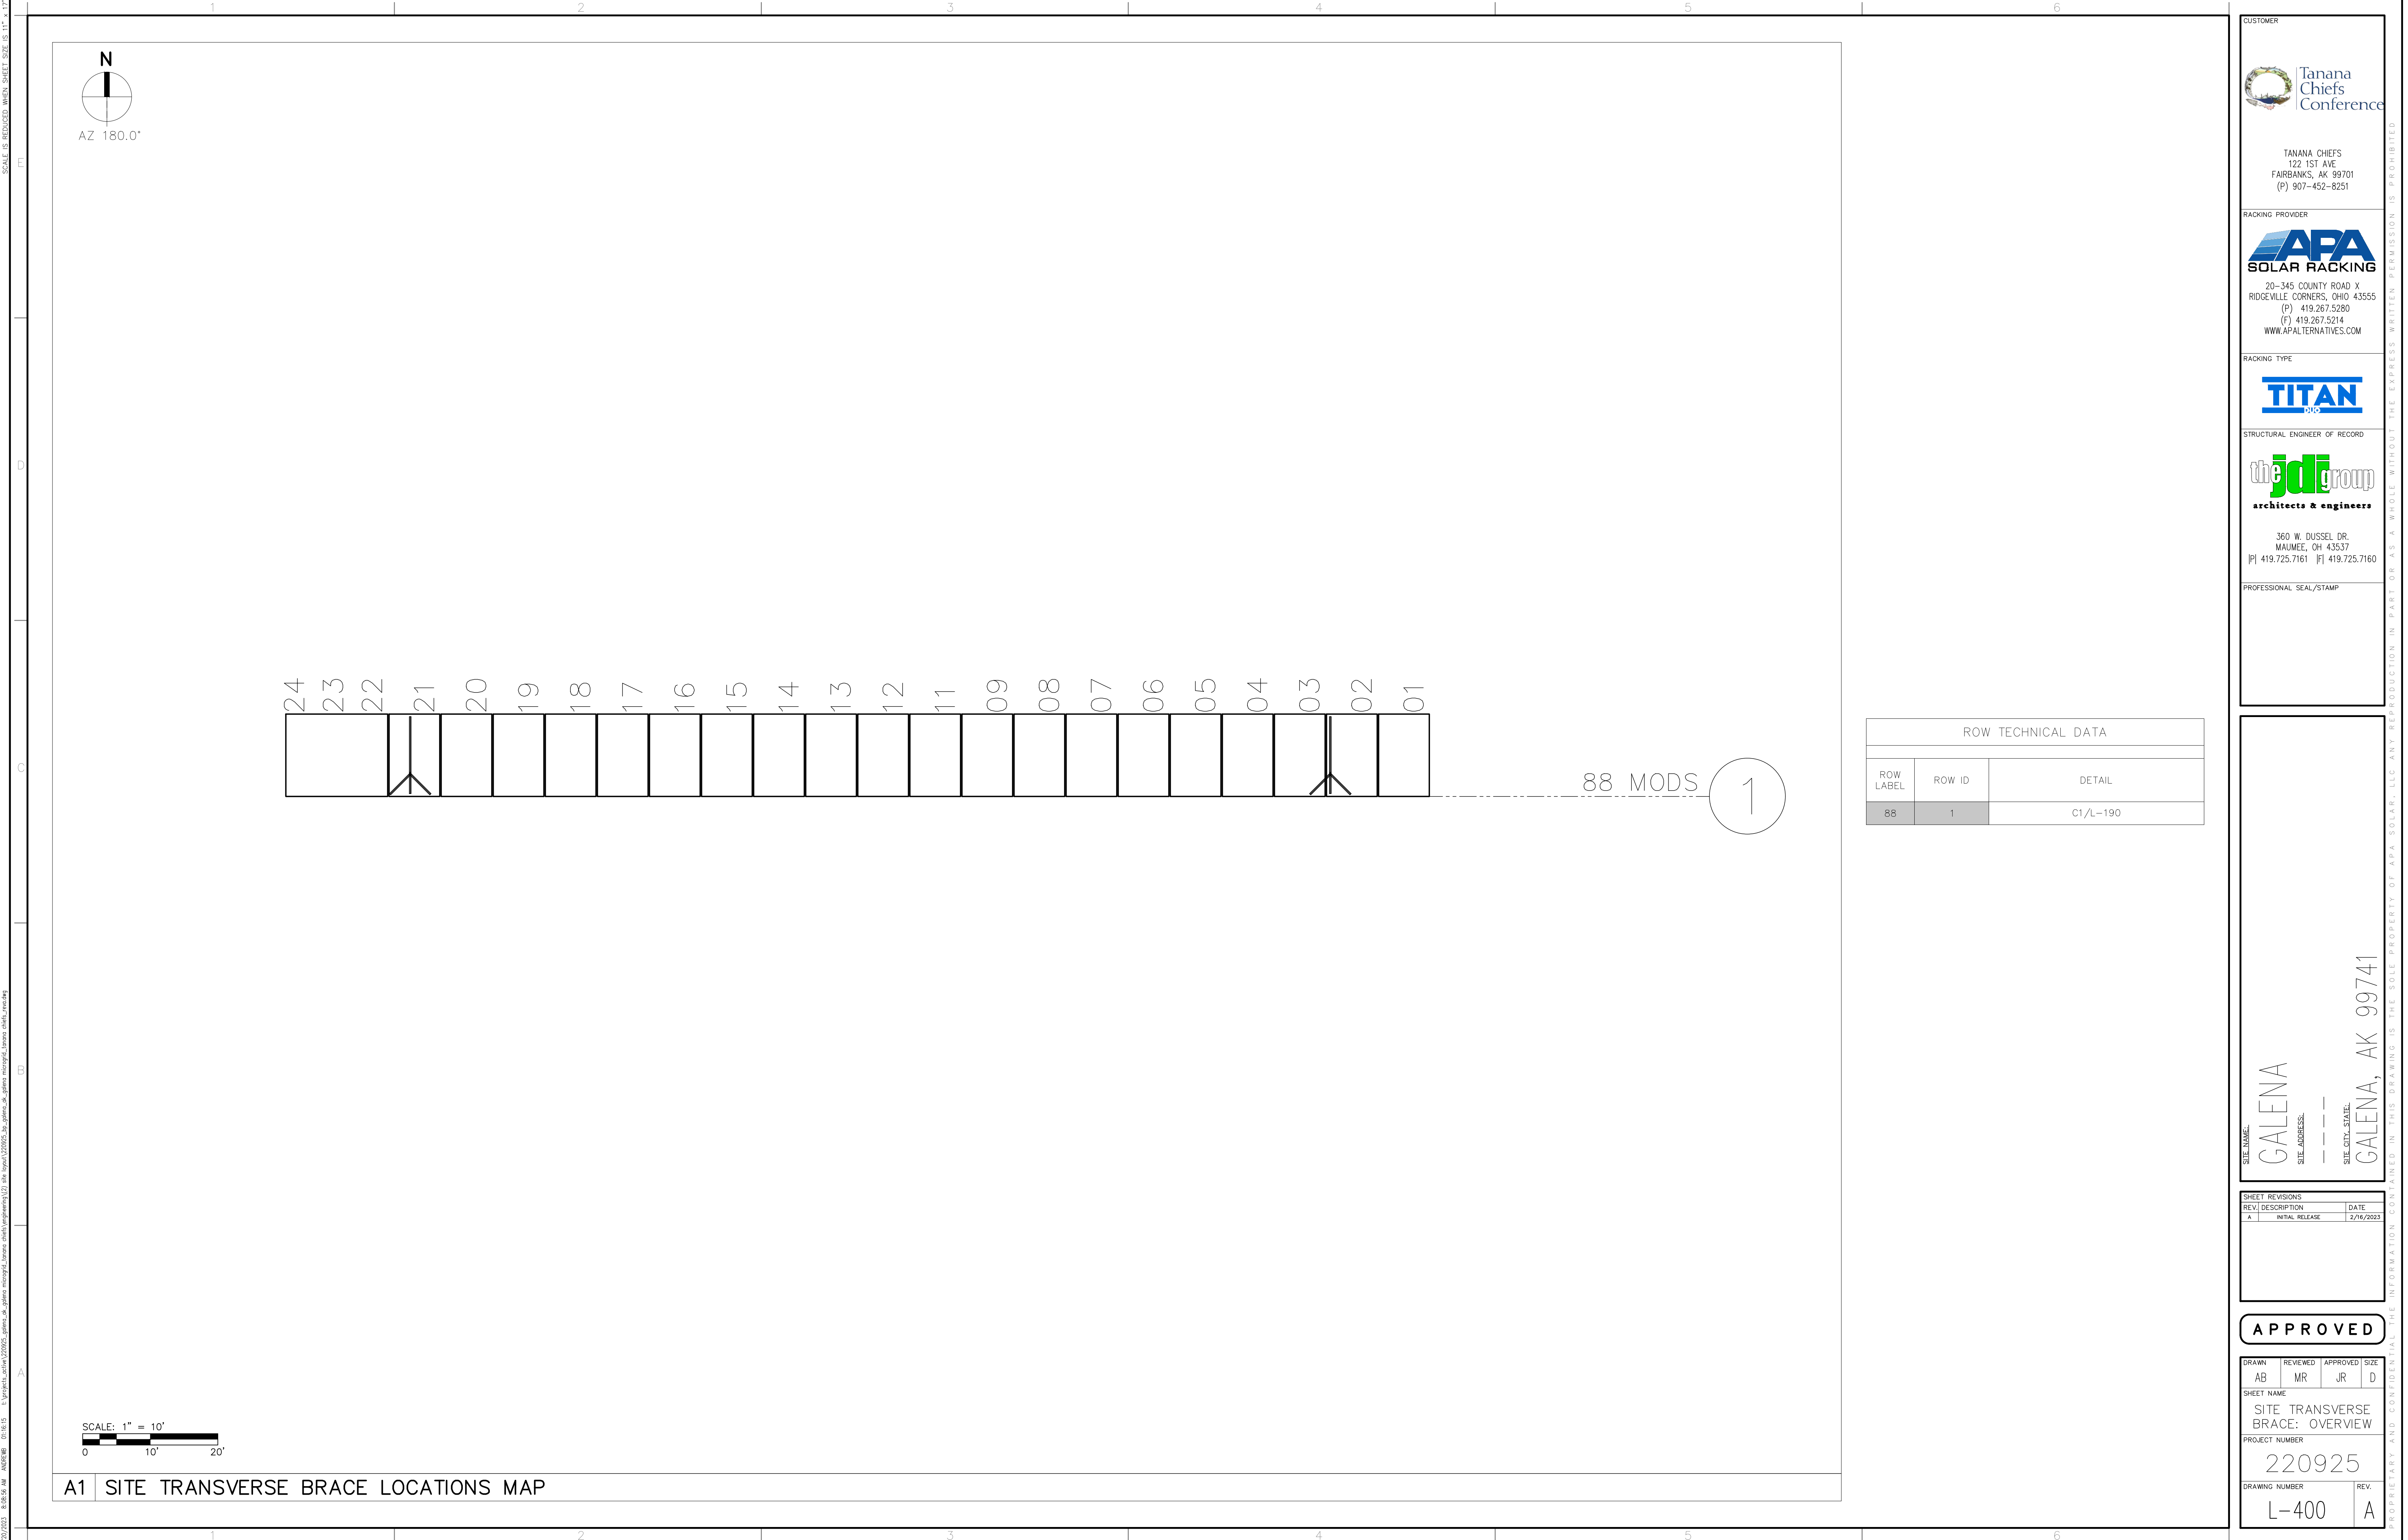

CUSTOMER



TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



STRUCTURAL ENGINEER OF RECORD



360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP

ROW TECHNICAL DATA		
ROW LABEL	ROW ID	DETAIL
88	1	C1/L-190

SITE NAME:  
GALENA

SITE ADDRESS:  
-----

SITE CITY, STATE:  
GALENA, AK 99741

SHEET REVISIONS	
REV.	DESCRIPTION
A	INITIAL RELEASE

APPROVED

DRAWN  
AB

REVIEWED  
MR

APPROVED  
JR


SIZE  
D

SHEET NAME  
SITE TRANSVERSE  
BRACE: OVERVIEW

PROJECT NUMBER  
220925

DRAWING NUMBER  
L-400

REV.  
A

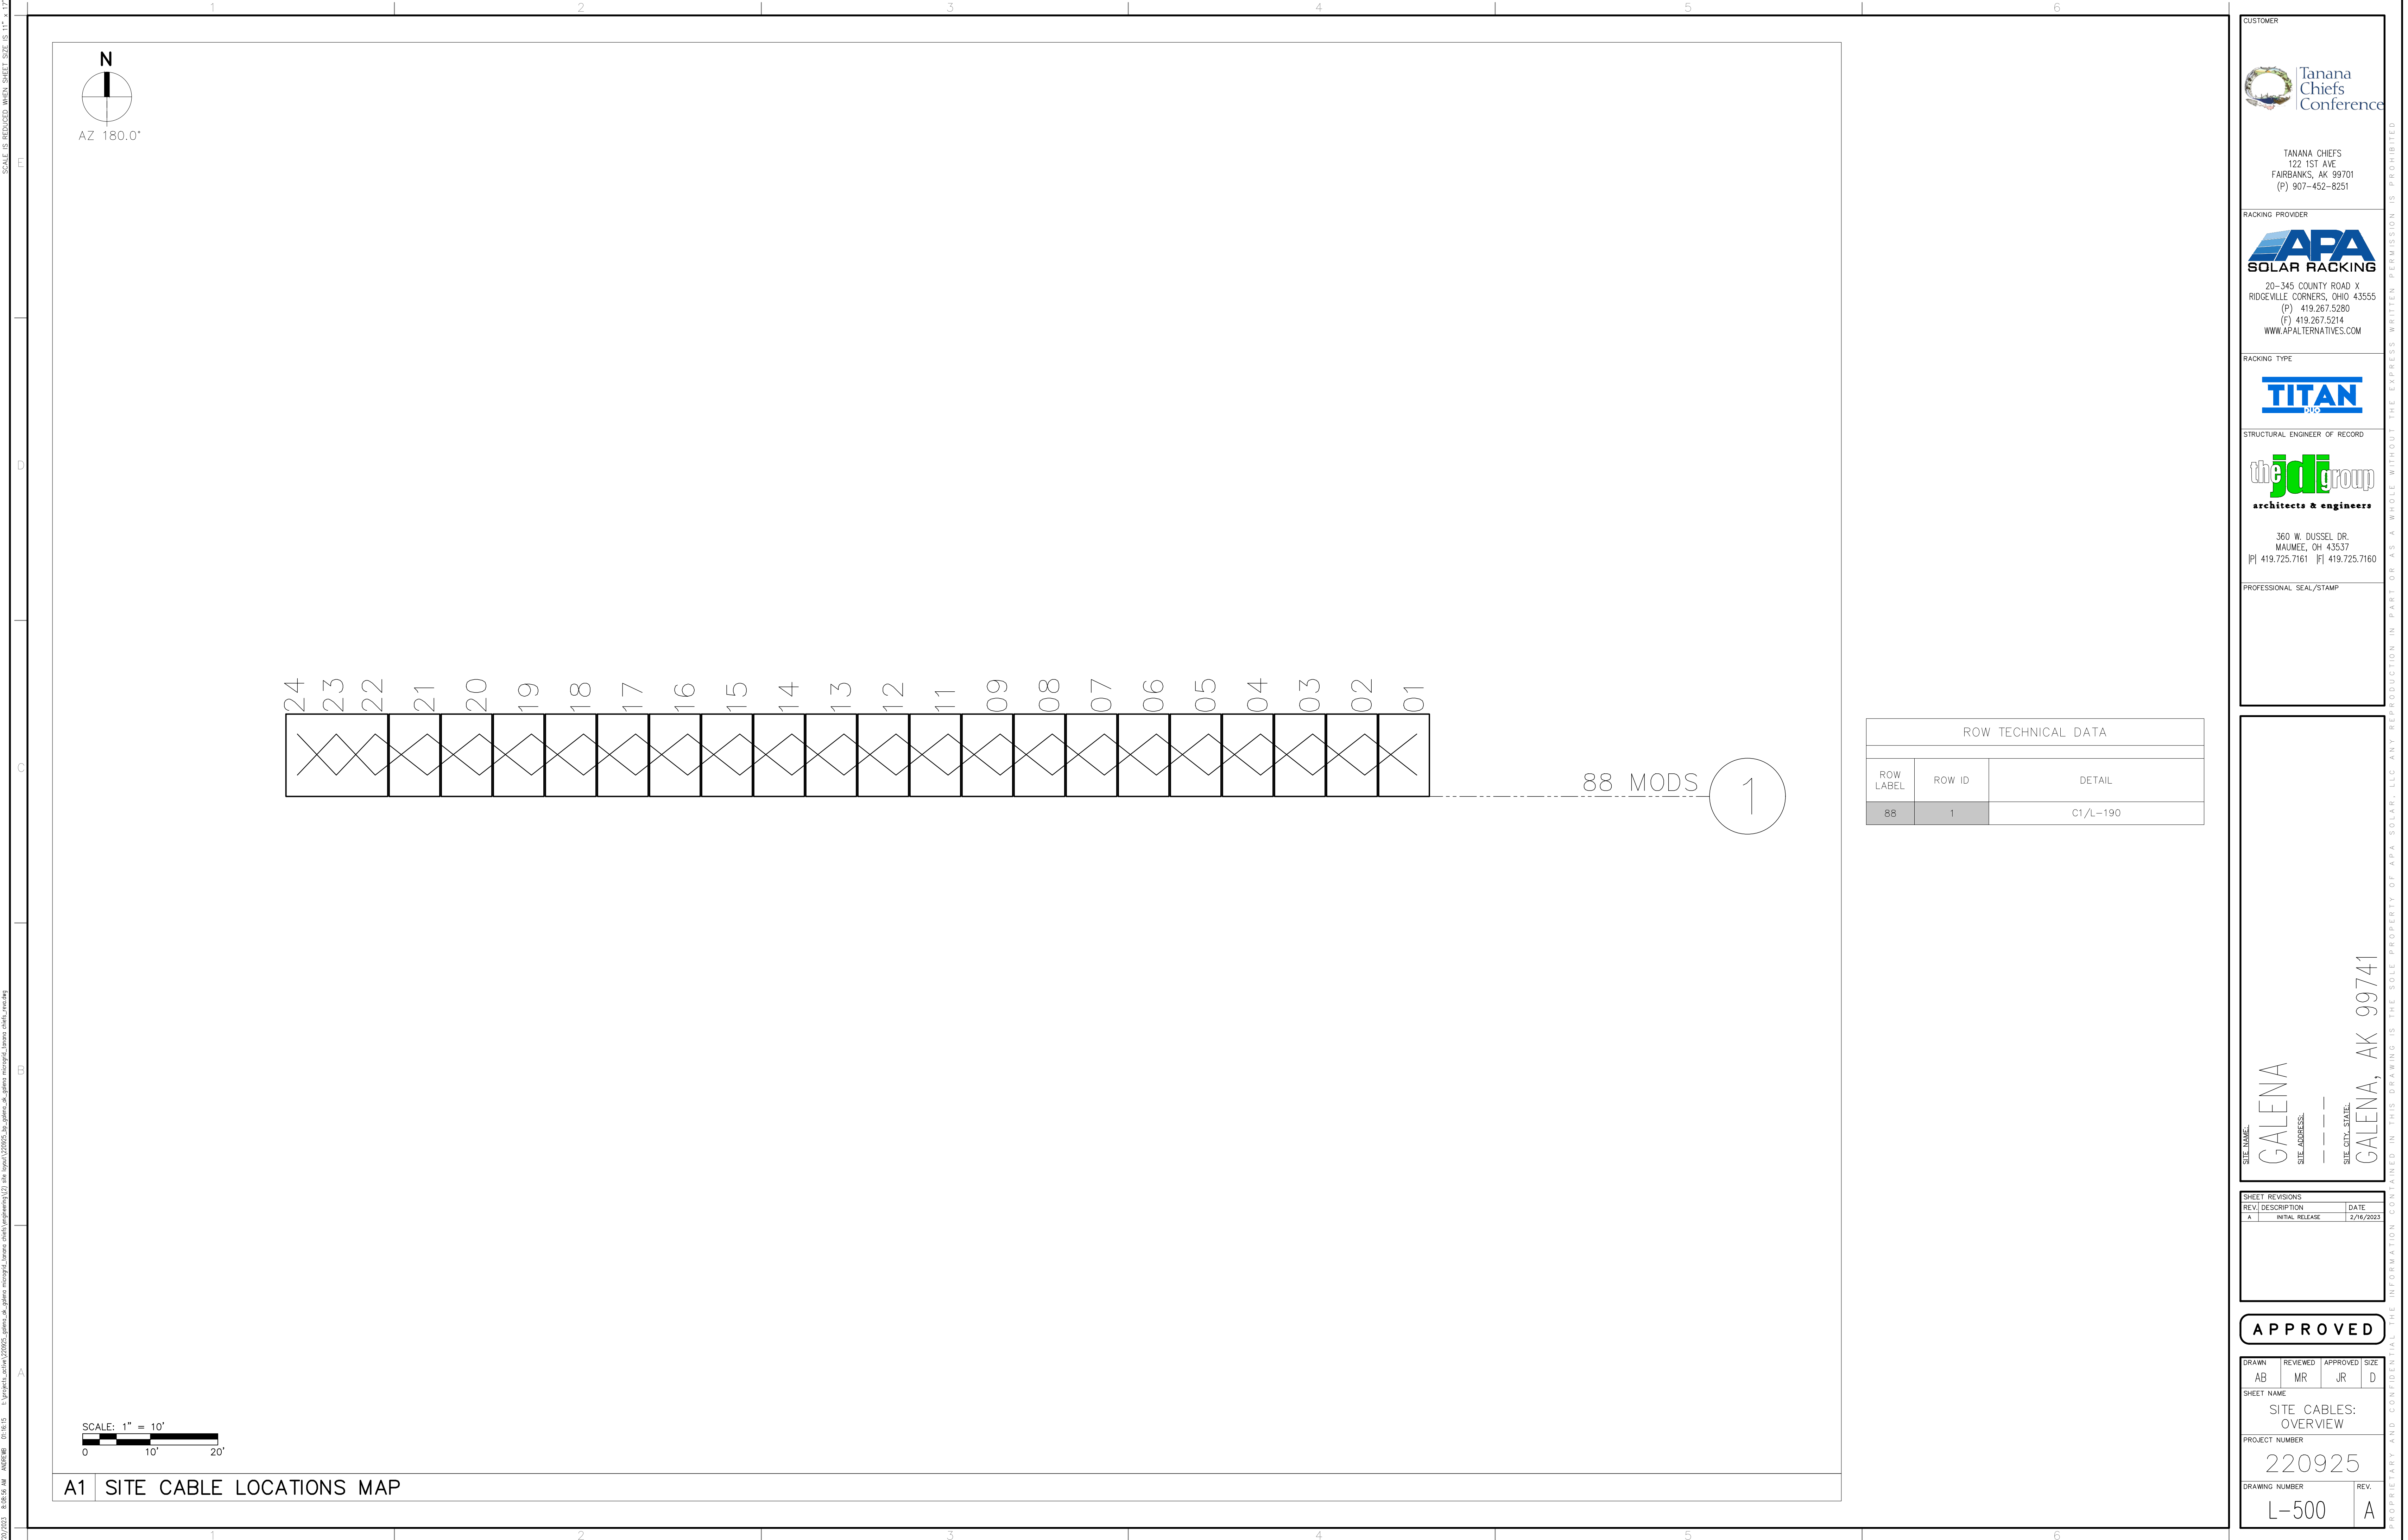

ROW TECHNICAL DATA		
ROW LABEL	ROW ID	DETAIL
88	1	C1/L-190

CUSTOMER



Tanana  
Chiefs  
Conference

TANANA CHIEFS  
122 1ST AVE  
FAIRBANKS, AK 99701  
(P) 907-452-8251

RACKING PROVIDER



APA  
SOLAR RACKING

20-345 COUNTY ROAD X  
RIDGEVILLE CORNERS, OHIO 43555  
(P) 419.267.5280  
(F) 419.267.5214  
WWW.APALTERNATIVES.COM

RACKING TYPE



TITAN  
RMC

STRUCTURAL ENGINEER OF RECORD



the  
jdi  
group  
architects & engineers

360 W. DUSSEL DR.  
MAUMEE, OH 43537  
[P] 419.725.7161 [F] 419.725.7160

PROFESSIONAL SEAL/STAMP

SITE NAME:  
GALENA

SITE ADDRESS:  
-----

SITE CITY, STATE:  
GALENA, AK 99741

SHEET REVISIONS		
REV.	DESCRIPTION	DATE
A	INITIAL RELEASE	2/16/2023

APPROVED

DRAWN AB	REVIEWED MR	APPROVED JR	SIZE D
SHEET NAME SITE CABLES: OVERVIEW			
PROJECT NUMBER 220925			
DRAWING NUMBER L-500			REV. A



# YUKON Series

Half-Cell  
Transparent Backsheet Module

**540-555W**

Module Power Output

**21.48%**

Max Efficiency



## Key Features



High module conversion efficiency



Better temperature coefficient



Super multi busbar technology



Low attenuation long warranty



Superior load capacity



Higher bifaciality




USA based liability insurance



Houston, Texas based company

## Warranty

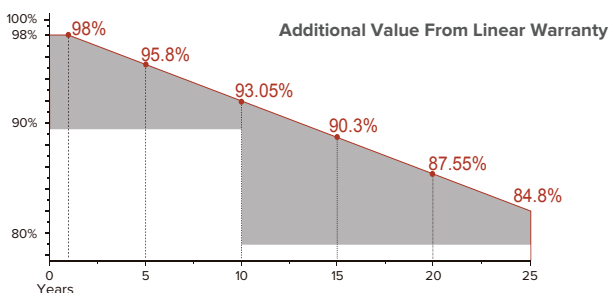

**15** <Years>  
Guarantee on product material and workmanship

**25** <Years>  
Linear power output warranty

## Product Certification

IEC61215:2016; IEC 61730:2016; UL1703; UL61730/ETL/CEC

IEC62804

PID

IEC61701

Salt Mist

IEC62716

Ammonia Resistance

IEC60068

Dust and Sand

IEC61215

Hailstone

Fire Type (UL61730):Type1

ISO14001:2015; ISO9001:2015; ISO45001:2018



## About SEG Solar

SEG Solar is a leading manufacturer of high-performance solar panels for residential, commercial, and utility applications. The company, headquartered in Houston, Texas, is committed to providing cost-effective and reliable solar solutions that help customers reduce their energy costs and carbon footprint.



Download Datasheet

## Electrical Characteristics

Module Type	SEG-540-BMA-TB			SEG-545-BMA-TB			SEG-550-BMA-TB			SEG-555-BMA-TB		
	Front STC	Front NOCT	Back STC	Front STC	Front NOCT	Back STC	Front STC	Front NOCT	Back STC	Front STC	Front NOCT	Back STC
Maximum Power -Pmp(W)	540	406	378	545	409	382	550	414	385	555	418	389
Open Circuit Voltage -Voc(V)	49.50	46.18	49.48	49.60	46.32	49.58	49.70	46.40	49.68	49.80	46.47	49.78
Short Circuit Current -Isc(A)	13.81	11.16	9.74	13.90	11.23	9.80	14.00	11.32	9.87	14.10	11.40	9.94
Maximum Power Voltage -Vmp(V)	41.55	38.39	41.61	41.80	38.41	41.86	42.05	38.58	42.10	42.31	38.75	42.35
Maximum Power Current -Imp(A)	13.00	10.59	9.09	13.04	10.65	9.13	13.08	10.73	9.15	13.12	10.79	9.19
Module Efficiency STC-ηm(%)	20.90			21.10			21.29			21.48		
Power Tolerance(W)	(0, +3%)											
Maximum System Voltage	1500V DC											
Maximum Series Fuse Rating	25 A											

STC: Irradiance 1000 W/m<sup>2</sup> module temperature 25°C AM=1.5

NOCT: Irradiance 800W/m<sup>2</sup> ambient temperature 20°C module temperature 45°C wind speed: 1m/s

Power measurement tolerance: +/-3%

## Mechanical Specifications

External Dimension	2278 x 1134 x 35 mm
Weight	27.0 kg
Solar Cells	PERC Mono 182 x 91mm(144 pcs)
Front Glass	3.2 / mm AR coating tempered glass / low iron
Frame	Anodized aluminium alloy
Junction Box	IP68 / 3 diodes
Connector Type	QC4.10
Cable Type / Length	12 AWG PV Wire (UL) /1200 mm
Mechanical Load(Front)	5400 Pa / 113 psf*
Mechanical Load(Rear)	3600 Pa / 75 psf*

\*Refer to SEG installation Manual for details


## Packing Configuration

Container	20'GP	40'HQ
Pieces per Pallet	31	31
Pallets per Container	4	20
Pieces per Container	124	620
341kw/container		

## Temperature Characteristics


Pmax Temperature Coefficient	-0.35 %/°C
Voc Temperature Coefficient	-0.27 %/°C
Isc Temperature Coefficient	+0.05 %/°C
Operating Temperature	-40~+85 °C
Nominal Operating Cell Temperature (NOCT)	45±2 °C

## Technical Drawing

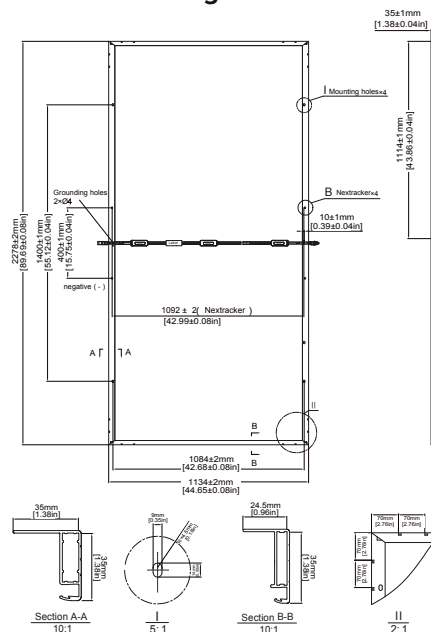

\*Refer to SEG installation Manual for details

## I-V Curve

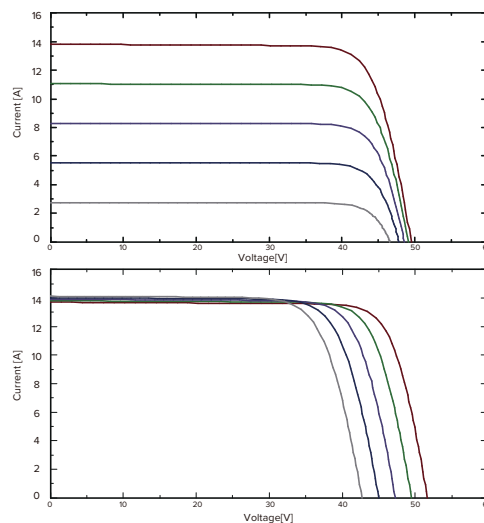

# SUNNY HIGHPOWER PEAK3 125-US / 150-US

SHP 125-US-20 / SHP 150-US-20



## Cost effective

- Modular architecture reduces BOS and maximizes system uptime
- Compact design and high power density maximize transportation and logistical efficiency

## Maximum flexibility

- Scalable 1,500 VDC building block with best-in-class performance
- Flexible architecture creates scalability while maximizing land usage

## Simple install, commissioning

- Ergonomic handling and simple connections enable quick installation
- Centralized commissioning and control with SMA Data Manager

## Highly innovative

- SMA Smart Connected reduces O&M costs and simplifies field-service
- Powered by award winning ennexOS cross sector energy management platform

## SUNNY HIGHPOWER PEAK3 125-US / 150-US

A superior modular solution for utility power plants

The new Sunny Highpower PEAK3 is SMA's latest addition to a comprehensive portfolio of utility solutions. This 1,500 VDC inverter offers high power density in a modular architecture that achieves a cost-optimized solution for utility-scale PV integrators. With fast, simple installation and commissioning, the Sunny Highpower PEAK3 is accelerating the path to energization. SMA has also brought its field-proven Smart Connected technology to the PEAK3, which simplifies O&M and contributes to lower lifetime service costs. The PEAK3 utility system solution is powered by the ennexOS cross sector energy management platform, 2018 winner of the Intersolar smarter E AWARD.



Technical Data *	Sunny Highpower PEAK3 125-US	Sunny Highpower PEAK3 150-US
<b>Input (DC)</b>		
Maximum array power	187500 Wp STC	225000 Wp STC
Maximum system voltage	1500 VDC	
MPP voltage range	710 V ... 1425 V	855 V ... 1425 V
MPP trackers	1	
Maximum operating input current	180 A	
Maximum input short-circuit current	325 A	
<b>Output (AC)</b>		
Nominal AC power	125000 W	150000 W
Maximum apparent power	125000 VA	150000 VA
Output phases / line connections	3 / 3-PE	
Nominal AC voltage	480 V	600 V
Compatible transformer winding configuration	Wye-grounded	
Maximum output current	151 A	
Rated grid frequency	60 Hz	
Grid frequency / range	50 Hz, 60 Hz / -6 Hz ... +6 Hz	
Power factor at rated power / adjustable displacement	1 / 0.0 leading ... 0.0 lagging	
Harmonics (THD)	<3%	
<b>Efficiency</b>		
CEC efficiency (preliminary)	98.5 %	98.5 %
<b>Protection and safety features</b>		
Ground fault monitoring: Riso / Differential current	● / ●	
DC reverse polarity protection	●	
AC short circuit protection	●	
Monitored surge protection (Type 2): DC / AC	● / ●	
Protection class / overvoltage category (as per UL 840)	I / IV	
<b>General data</b>		
Device dimensions (W / H / D)	770 / 830 / 444 mm (30.3 / 32.7 / 17.5 in.)	
Device weight	85 kg (185 lbs)	
Operating temperature range	-25°C ... +60°C (-13°F ... +140°F)	
Storage temperature range	-40°C ... +70°C (-40°F ... +158°F)	
Audible noise emission (full power @ 1m and 25°C)	< 65 dB(A)	
Internal consumption at night	< 5 W	
Topology	Transformerless	
Cooling concept	OptiCool (forced convection, variable speed fans)	
Enclosure protection rating	Type 4X (as per UL 50E)	
Maximum permissible relative humidity (non-condensing)	100%	
<b>Additional information</b>		
Mounting	Rack mount	
DC connection	Terminal lugs - up to 600 kcmil CU/AL	
AC connection	Screw terminals - up to 300 kcmil CU/AL	
LED indicators (Status/Fault/Communication)	●	
SMA Speedwire (Ethernet network interface)	● (2 x RJ45 ports)	
Data protocols: SMA Modbus / SunSpec Modbus / Webconnect	● / ● / ●	
OptiTrac Global Peak (shade tolerant MPP tracking)	●	
PID Mitigation Solution	○	
Integrated Plant Control / Q on Demand 24/7	● / ●	
Off-grid capable / SMA Fuel Save Controller compatible	● / ●	
SMA Smart Connected (proactive monitoring and service)	●	
<b>Certifications</b> (pending as of June 2018)		
Certifications and approvals	UL 1741, UL 1998, IEEE 1547, CAN/CSA-C22.2 No.62109	
FCC compliance	FCC Part 15, Class A	
Grid interconnection standards	UL 1741 SA - CA Rule 21, HECO Rule 14H, PRC-024-02	
Advanced grid support capabilities	L/HFRT, L/HVRT, Volt-VAr, Volt-Watt, Frequency-Watt, Ramp Rate Control, Fixed Power Factor	
<b>Warranty</b>		
Standard	5 years	
Optional extensions	10 / 15 / 20 years	
Type designation	SHP 125-US-20	SHP 150-US-20
* Preliminary data as of June 2018   ● Standard features   ○ Optional features		

SHP\_125/150-US-20-12 - Changes to product and services, including those resulting from country-specific requirements, as well as deviations from technical data are subject to change at any time without notice. SMA assumes no liability for typographical or other errors. Please visit [www.sma-america.com](http://www.sma-america.com) for the latest information.